

ASME B16.18-2018
(Revision of ASME B16.18-2012)



Cast Copper Alloy Solder Joint Pressure Fittings

www.fouladline.com

AN AMERICAN NATIONAL STANDARD



**The American Society of
Mechanical Engineers**

ASME B16.18-2018
(Revision of ASME B16.18-2012)

Cast Copper Alloy Solder Joint Pressure Fittings

www.fouladline.com

AN AMERICAN NATIONAL STANDARD



**The American Society of
Mechanical Engineers**

Two Park Avenue • New York, NY • 10016 USA

www.fouladline.com

Date of Issuance: May 8, 2018

The next edition of this Standard is scheduled for publication in 2023.

ASME issues written replies to inquiries concerning interpretations of technical aspects of this Standard. Periodically certain actions of the ASME B16 Committee may be published as Cases. Cases and interpretations are published on the ASME website under the Committee Pages at <http://cstools.asme.org/> as they are issued.

Errata to codes and standards may be posted on the ASME website under the Committee Pages to provide corrections to incorrectly published items, or to correct typographical or grammatical errors in codes and standards. Such errata shall be used on the date posted.

The Committee Pages can be found at <http://cstools.asme.org/>. There is an option available to automatically receive an e-mail notification when errata are posted to a particular code or standard. This option can be found on the appropriate Committee Page after selecting “Errata” in the “Publication Information” section.

ASME is the registered trademark of The American Society of Mechanical Engineers.

This code or standard was developed under procedures accredited as meeting the criteria for American National Standards. The Standards Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed code or standard was made available for public review and comment that provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not “approve,” “rate,” or “endorse” any item, construction, proprietary device, or activity.

ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor assume any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, that precludes the issuance of interpretations by individuals.

No part of this document may be reproduced in any form,
in an electronic retrieval system or otherwise,
without the prior written permission of the publisher.

The American Society of Mechanical Engineers
Two Park Avenue, New York, NY 10016-5990

Copyright © 2018 by
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS
All Rights Reserved
Printed in U.S.A.

CONTENTS

Foreword	v
Committee Roster	vi
Correspondence With the B16 Committee	vii
Summary of Changes	ix
List of Changes in Record Number Order	x
1 Scope	1
2 General	1
3 Pressure–Temperature Ratings	1
4 Fitting Size and Ends	1
5 Marking	1
6 Material	2
7 Metal Thickness	2
8 Inspection Tolerance	2
9 Threaded Ends	2
10 Configuration of Threaded Ends	3
11 Production Testing	3
Mandatory Appendix	
I References	23
Nonmandatory Appendices	
A Strength of Solder Joints	24
B Fitting Rating	26
C Quality System Program	27
Figure	
4-1 Method of Designating Openings of Fittings	5
Tables	
3.1-1 Internal Pressure–Temperature Ratings for Cast Copper Alloy Fittings, psi (kPa)	4
8.2-1 Inspection Tolerances	6
8.2-2 Dimensions of Solder Joint Ends	7
8.2-3 Dimensions of Couplings	8
8.2-4 Dimensions of Elbows, Tees, and 45-deg Elbows	9
8.2-5 Dimensions of Reducing 90-deg Elbows	10
8.2-6 Dimensions of Reducing Tees	11
8.2-7 Dimensions of Caps and Plugs	13
8.2-8 Dimensions of Fitting Reducers	14

8.2-9	Dimensions of Solder Joint Elbows and Tees With Pipe Thread Ends (Straight Sizes)	15
8.2-10	Dimensions of Solder Joint Elbows and Tees With Pipe Thread Ends (Reducing Sizes)	17
8.2-11	Dimensions of Solder Joint Adapters and Fitting Adapters With Pipe Thread Ends (Straight and Reducing Sizes)	19
8.2-12	Dimensions of Return Bends (Straight Sizes)	20
8.2-13	Dimensions of Supply and Return Tees	20
8.2-14	Dimensions of Baseboard Tees (F × F × C)	21
8.2-15	Dimensions of Tees	21
8.2-16	Dimensions of Baseboard Tees (C × F × C)	21
8.2-17	Dimensions of Flush Bushings (FTG × C)	22
8.2-18	Dimensions of Flush Bushings (FTG × F)	22
A-1	Pressure-Temperature Ratings	25

www.fouladline.com

FOREWORD

This American National Standard for solder joint fittings was originally developed by a subcommittee of American Standards Association (ASA) Sectional Committee A40 on Minimum Requirements for Plumbing and Standardization of Plumbing Equipment, organized in August 1928, under the procedures of the ASA. Subcommittee No. 11 on Solder-Joint Fittings for Tubing was appointed in October 1936.

At its first meeting, the Subcommittee was informed of the investigation of solder joints being carried out by the National Bureau of Standards (now the National Institute of Standards and Technology). It was decided that the Subcommittee's scope should cover only solder fittings for use in plumbing. A subgroup was appointed to study the tolerances of commercial fittings, including depth of bore, laying lengths, and diameters of copper tube.

A draft standard was sent to the Subcommittee in February 1939; a revision was distributed in August to selected organizations and individuals for review. A new Subcommittee draft dated April 1940 was approved by Sectional Committee A40, the sponsor, and following ASA approval, was published in January 1941 as ASA A40.3-1941.

In 1949, the sponsors agreed to transfer responsibility for solder joint fittings to Sectional Committee B16 of ASA, because the fittings were being used in many applications other than plumbing. Subcommittee 9, Standardization of Solder Joint Fittings was established and charged with developing a revised standard. An April 1949 draft was distributed for industry review, resulting in recommended changes. A new draft was approved by Sectional Committee B16, sponsor organizations, and ASA, and published as ASA B16.18-1950.

Work began in 1958 on a revision, including improvements in language. It was approved by B16, sponsor organizations, and ASA, and published as ASA B16.18-1963. Starting in 1969, a comprehensive review resulted in revisions to clarify the text and to permit additional material. Final approval was granted by the American National Standards Institute [ANSI (formerly ASA)] on March 2, 1972, for publication as ANSI B16.18-1972.

The Subcommittee, now Subcommittee I, began a new revision on 1974, resulting in the addition of supply and return tees, baseboard tees, and flush bushings, as well as metrication, and change of "bronze" to "copper alloy." The draft that was finally approved was published as ANSI B16.18-1978.

In 1982, American National Standards Committee B16 became the ASME B16 Standards Committee, operating with the same scope under ASME procedures accredited by ANSI. Subsequently, Subcommittee I merged with Subcommittee J, which had a related scope. A general review was then started, resulting in a number of editorial changes and a few pictorial corrections. Following approval by Subcommittee J, the B16 Standards Committee, and ASME, ANSI granted approval on January 13, 1984, for publication of the standard as ANSI B16.18-1984. The standard was reaffirmed in 1994 with no change.

The 2001 edition of B16.18 contained a defined bursting strength, defined standard gaging method of threaded ends, and other clarifications and updates to text. Following approval by the Standards Committee and ASME, the edition was approved as an American National Standard on October 17, 2001, with the designation ASME B16.18-2001.

In the 2012 edition, new copper alloys were added for potable water applications. Also, references to ASME standards were revised to no longer list specific edition years; the latest edition of ASME publications applied, unless stated otherwise. Materials manufactured to other editions of the referenced ASTM standards were permitted to be used to manufacture fittings meeting the requirements of this Standard as long as the fitting manufacturer verified that the material met the requirements of the referenced edition. Following approval by the B16 Standards Committee and the ASME Board on Pressure Technology Codes and Standards, the 2012 edition was approved as an American National Standard by ANSI on January 13, 2012, with the new designation ASME B16.18-2012.

In this 2018 edition, the Material section has been revised to add low-lead requirements for castings intended for use in potable water systems. Following approval by the ASME B16 Standards Committee, ASME B16.18-2018 was approved as an American National Standard by ANSI on February 16, 2018.

ASME B16 COMMITTEE

Standardization of Valves, Flanges, Fittings, and Gaskets

(The following is the roster of the Committee at the time of approval of this Standard.)

STANDARDS COMMITTEE OFFICERS

R. M. Bojarczuk, *Chair*
C. E. Davila, *Vice Chair*
C. R. Ramcharran, *Secretary*

STANDARDS COMMITTEE PERSONNEL

A. Appleton , Alloy Stainless Products Co., Inc.	R. C. Merrick , Fluor Enterprises
J. E. Barker , Dezurik Water Controls	M. L. Nayyar , NICE
K. Barron , Ward Manufacturing	W. H. Patrick , Dow Chemical Co.
D. C. Bayreuther , Metso Automation	D. W. Rahoi , CCM 2000
W. B. Bedesem , Consultant	C. R. Ramcharran , The American Society of Mechanical Engineers
R. M. Bojarczuk , ExxonMobil Research & Engineering Co.	D. F. Reid , VSP Technologies
A. M. Cheta , Qatar Shell GTL	R. A. Schmidt , Canadoil
M. A. Clark , NIBCO, Inc.	J. P. Tucker , Flowserve Corp.
G. A. Cuccio , Capitol Manufacturing Co.	F. R. Volstadt , Volstadt & Associates, Inc.
C. E. Davila , Crane Energy	F. Feng , <i>Delegate</i> , China Productivity Center for Machinery
J. D'Avanzo , Fluoroseal Valves	R. W. Barnes , <i>Contributing Member</i> , Anric Enterprises, Inc.
K. S. Felder , Valero Energy	P. V. Craig , <i>Contributing Member</i> , Jomar Group
D. R. Frikken , Becht Engineering Co., Inc.	B. G. Fabian , <i>Contributing Member</i> , Pennsylvania Machine Works
D. Hunt, Jr. , Fastenal	M. Katcher , <i>Contributing Member</i> , Haynes International
G. A. Jolly , Samshin Ltd.	A. G. Kireta, Jr. , <i>Contributing Member</i> , Copper Development Association, Inc.
E. J. Lain , Exelon Nuclear	
T. A. McMahon , Emerson Process Management	

SUBCOMMITTEE J — COPPER AND COPPER ALLOY FLANGES, FLANGED FITTINGS, AND SOLDER JOINT FITTINGS

A. G. Kitera, Jr. , <i>Chair</i> , Copper Development Association, Inc.	W. E. Chapin , Professional Code Consulting, LLC
M. A. Clark , <i>Vice Chair</i> , NIBCO, Inc.	D. R. Frikken , Becht Engineering Co., Inc.
E. Lawson , <i>Secretary</i> , The American Society of Mechanical Engineers	A. A. Knapp , A. Knapp & Associates
J. Oh , <i>Secretary</i> , The American Society of Mechanical Engineers	C. A. Mueller , Mueller Industries, Inc.
J. A. Ballanco , JB Engineering & Code Consulting	F. Shingleton , Viega, LLC
S. L. Cavanaugh , Cavanaugh Consulting	G. Morgan , <i>Alternate</i> , Viega, LLC

CORRESPONDENCE WITH THE B16 COMMITTEE

General. ASME Standards are developed and maintained with the intent to represent the consensus of concerned interests. As such, users of this Standard may interact with the Committee by requesting interpretations, proposing revisions or a case, and attending Committee meetings. Correspondence should be addressed to:

Secretary, B16 Standards Committee
The American Society of Mechanical Engineers
Two Park Avenue
New York, NY 10016-5990
<http://go.asme.org/Inquiry>

Proposing Revisions. Revisions are made periodically to the Standard to incorporate changes that appear necessary or desirable, as demonstrated by the experience gained from the application of the Standard. Approved revisions will be published periodically.

The Committee welcomes proposals for revisions to this Standard. Such proposals should be as specific as possible, citing the paragraph number(s), the proposed wording, and a detailed description of the reasons for the proposal, including any pertinent documentation.

Proposing a Case. Cases may be issued to provide alternative rules when justified, to permit early implementation of an approved revision when the need is urgent, or to provide rules not covered by existing provisions. Cases are effective immediately upon ASME approval and shall be posted on the ASME Committee web page.

Requests for Cases shall provide a Statement of Need and Background Information. The request should identify the Standard and the paragraph, figure, or table number(s), and be written as a Question and Reply in the same format as existing Cases. Requests for Cases should also indicate the applicable edition(s) of the Standard to which the proposed Case applies.

Interpretations. Upon request, the B16 Standards Committee will render an interpretation of any requirement of the Standard. Interpretations can only be rendered in response to a written request sent to the Secretary of the B16 Standards Committee.

Requests for interpretation should preferably be submitted through the online Interpretation Submittal Form. The form is accessible at <http://go.asme.org/InterpretationRequest>. Upon submittal of the form, the Inquirer will receive an automatic e-mail confirming receipt.

If the Inquirer is unable to use the online form, he/she may e-mail the request to the Secretary of the B16 Standards Committee at SecretaryB16@asme.org, or mail it to the above address. The request for an interpretation should be clear and unambiguous. It is further recommended that the Inquirer submit his/her request in the following format:

Subject:	Cite the applicable paragraph number(s) and the topic of the inquiry in one or two words.
Edition:	Cite the applicable edition of the Standard for which the interpretation is being requested.
Question:	Phrase the question as a request for an interpretation of a specific requirement suitable for general understanding and use, not as a request for an approval of a proprietary design or situation. Please provide a condensed and precise question, composed in such a way that a "yes" or "no" reply is acceptable.
Proposed Reply(ies):	Provide a proposed reply(ies) in the form of "Yes" or "No," with explanation as needed. If entering replies to more than one question, please number the questions and replies.
Background Information:	Provide the Committee with any background information that will assist the Committee in understanding the inquiry. The Inquirer may also include any plans or drawings that are necessary to explain the question; however, they should not contain proprietary names or information.

Requests that are not in the format described above may be rewritten in the appropriate format by the Committee prior to being answered, which may inadvertently change the intent of the original request.

Moreover, ASME does not act as a consultant for specific engineering problems or for the general application or understanding of the Standard requirements. If, based on the inquiry information submitted, it is the opinion of the Committee that the Inquirer should seek assistance, the inquiry will be returned with the recommendation that such assistance be obtained.

ASME procedures provide for reconsideration of any interpretation when or if additional information that might affect an interpretation is available. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME Committee or Subcommittee. ASME does not “approve,” “certify,” “rate,” or “endorse” any item, construction, proprietary device, or activity.

Attending Committee Meetings. The B16 Standards Committee regularly holds meetings and/or telephone conferences that are open to the public. Persons wishing to attend any meeting and/or telephone conference should contact the Secretary of the B16 Standards Committee.

www.fouladline.com

ASME B16.18-2018

SUMMARY OF CHANGES

Following approval by the ASME B16 Committee and ASME, and after public review, ASME B16.18-2018 was approved by the American National Standards Institute on February 16, 2018.

In ASME B16.18-2018, the Metric tables formerly in Mandatory Appendix I have been merged with the U.S. Customary tables in the main text; the tables have been redesignated, Mandatory Appendix I deleted, and the cross-references updated accordingly. In addition, this edition includes the following changes identified by a margin note, **(18)**. The Record Number listed below is explained in more detail in the “List of Changes in Record Number Order” following this Summary of Changes.

<i>Page</i>	<i>Location</i>	<i>Change (Record Number)</i>
2	6	Subparagraph (b) revised (17-1691)
23	Mandatory Appendix I	Formerly Mandatory Appendix II, updated (17-1691)

LIST OF CHANGES IN RECORD NUMBER ORDER

Record Number	Change
17-1691	In section 6, subpara. (b), "either" was changed to "low lead (0.25% or less) and shall be"; in Mandatory Appendix I (formerly Mandatory Appendix II), references were updated.

www.fouladline.com

CAST COPPER ALLOY SOLDER JOINT PRESSURE FITTINGS

1 SCOPE

This Standard for cast copper alloy solder joint pressure fittings designed for use with copper water tube establishes requirements for

- (a) pressure-temperature ratings
- (b) abbreviations for end connections
- (c) sizes and method of designating openings of fittings
- (d) marking
- (e) material
- (f) dimensions and tolerances
- (g) tests

2 GENERAL

2.1 Relevant Units

This Standard states values in both SI (Metric) and U.S. Customary units. These systems of units are to be regarded separately as standard. Within the text, the SI units are shown in parentheses. The values stated in each system are not exact equivalents; therefore, it is required that each system of units be used independently of the other. Combining values from the two systems constitutes nonconformance with the Standard.

2.2 References

Standards and specifications adopted by reference in this Standard are shown in [Mandatory Appendix I](#), which is part of this Standard. It is not considered practical to identify the specific edition of each standard and specification in the individual references. Instead, the specific edition reference is identified in [Mandatory Appendix I](#).

2.3 Quality System

Requirements relating to the product manufacturer's quality system programs are described in [Nonmandatory Appendix C](#).

3 PRESSURE-TEMPERATURE RATINGS

3.1 Rating of Fitting and of Joint

The internal pressure-temperature ratings of the fittings are shown in [Table 3.1-1](#).

The internal pressure-temperature rating for a solder joint fitting is dependent not only on fitting and tube strength, but also on the composition of the solder used for the joint and selection of valves and appurtenances.

The internal pressure-temperature rating of the system shall be the lowest of the values shown in [Table 3.1-1](#), the solder joint, and those of the tube, valves, or appurtenances.

The maximum recommended pressure-temperature ratings for solder joints using the dimensions of [Table 8.2-2](#), made with typical commercial solders, are given in [Nonmandatory Appendix A](#).

3.2 Bursting Strength

Burst strength at $73^{\circ}\text{F} \pm 5^{\circ}\text{F}$ ($23^{\circ}\text{C} \pm 2^{\circ}\text{C}$) shall be not less than 4 times the 100°F (38°C) internal working-pressure rating shown in [Table 3.1-1](#). For reducing fittings, the applicable internal working pressure shall be that of the largest size of end connection.

4 FITTING SIZE AND ENDS

The size of the fittings shown in [Table 8.2-2](#) and [Table A-1](#) corresponds to standard water tube size as shown in ASTM B88, Standard Specification for Seamless Copper Water Tube. The size of the threaded ends corresponds to nominal pipe size as shown in ANSI/ASME B1.20.1.

Fittings are designated by the size of the openings in the sequence illustrated in [Figure 4-1](#).

The following symbols are used to designate the type of fitting end:

- C = solder-joint fitting end made to receive copper tube diameter (female)
- F = internal ANSI standard taper pipe thread (female) NPT
- FTG = solder-joint fitting end made to copper tube diameter (male)
- M = external ANSI standard taper pipe thread (male) NPT

5 MARKING

Each fitting shall be permanently marked with the manufacturer's name or trademark and other applicable markings as required by MSS SP-25. Marking of fittings less than Standard Water Tube Size $\frac{1}{2}$ or on any fitting where it damages soldering surfaces is not required.

Fittings manufactured from cast copper alloys containing silicon shall be permanently marked with the designation Si.

Fittings manufactured from cast copper alloys containing bismuth shall be permanently marked with the designation B or Bi.

(18) 6 MATERIAL

(a) Castings intended for use in applications up to 400°F (204°C) shall be of a copper alloy produced to meet

(1) the requirement of ASTM B62 Alloy C83600

(2) the tensile requirements of ASTM B584 Alloy C83800 or C84400 and, in all other respects, shall comply with the requirements of ASTM B62

(b) Castings intended for use in potable water applications up to 200°F (93°C) shall be low lead (0.25% or less) and shall be

(1) of a copper alloy produced to meet the requirements of ASTM B584 Alloy C87850 or C89833, or

(2) of other cast copper alloys, provided the fittings produced meet mechanical and corrosion-resistant properties needed for potable water application

7 METAL THICKNESS

Dimensional variations occur in the casting process. Pattern equipment shall be designed to produce the metal thickness given for fittings in [Table 8.2-2](#). The minimum wall thickness shall be not less than 90% of the body and joint wall thickness as shown in [Table 8.2-2](#).

8 INSPECTION TOLERANCE**8.1 Convention**

For determining conformance with this Standard, the convention for fixing significant digits where limits (maximum or minimum values) are specified shall be as defined in ASTM E29. This requires that an observed or calculated value be rounded off to the nearest unit in the last right-hand digit used for expressing the limit. Decimal values and tolerances do not imply a particular method of measurement.

8.2 Linear Dimensions

An inspection tolerance as shown in [Table 8.2-1](#) shall be allowed on center-to-shoulder, center-to-center, center-to-threaded-end, and shoulder-to-threaded-end dimensions on all fittings having female solder (solder cup) ends, and on center-to-solder-end and solder-to-threaded-end dimensions on all fittings having male solder (fitting) ends.

Coupling inspection limits for shoulder-to-shoulder and shoulder-to-end dimensions shall be double those shown in [Table 8.2-1](#), except that the minus tolerance applied to dimensions *M*, *N*, and *W* in [Tables 8.2-3](#) shall not result in a dimension less than 0.06 in. (1.5 mm) for sizes $\frac{1}{4}$ through 1 in., inclusive, or a dimension less than 0.09 in. (2.3 mm) for the larger sizes.

The largest opening in the fitting governs the tolerance to be applied to all openings.

[Tables 8.2-2](#) through [8.2-18](#) offer dimensions for pressure fittings covered by this Standard.

8.3 Ovality

Maximum ovality shall not exceed 1% of the maximum diameters shown in [Table 8.2-2](#). The average of the maximum and minimum diameters must be within the dimensions shown in the table.

8.4 Gaging of Solder Joint Ends

8.4.1 Standard Gaging Method. The standard method of gaging the diameter tolerances for male and female ends shall be by the use of plain plug and ring gages designed to hold the product within the limits established in [Table 8.2-2](#).

8.4.2 Optional Gaging Method. For gaging the diameter tolerance of male and female ends, the manufacturer may use direct reading instruments instead of ring and plug gages as specified in [para. 8.4.1](#). When gaging the diameters of male and female ends using direct reading instruments, refer to [para. 8.3](#).

8.5 Standard Gaging Method of Threaded Ends

The standard method of gaging the external and internal threaded ends shall be in accordance with the requirements of ANSI/ASME B1.20.1.

8.6 Alignment

The maximum-allowable deviation in the angular alignment of any opening shall be 0.06 in./ft (5 mm/m) (0.5%).

9 THREADED ENDS**9.1 Thread Type**

Fitting threads shall be right hand, conforming to ANSI/ASME B1.20.1, Pipe Threads, General Purpose (Inch). They shall be taper threads (NPT).

9.2 Countersink or Chamfer

All internal threads shall be countersunk a distance not less than one-half the pitch of the thread at an angle approximately 45 deg with the axis of the thread, and all external threads shall be chamfered at an angle of 30 deg to 45 deg from the axis, for easier entrance in making a joint and protection of the thread. Countersinking and chamfering shall be concentric with the threads.

9.3 Threading Tolerances

Tolerance for an internal threaded end having an internal shoulder shall be from the gage reference point (notch) to one turn small. Tolerance for an internal threaded end without shoulder and for an external

threaded end shall be from one turn small to one turn large.

9.4 Thread Length

The length of threads specified in all tables shall be measured to include the countersink or chamfer.

10 CONFIGURATION OF THREADED ENDS

At the manufacturer's option, female ends of fittings may be furnished with a polygon or bead with or without ribs, and male ends of fittings may be furnished with a polygon, ribs, or flats.

11 PRODUCTION TESTING

Each fitting shall be tested for evidence of leakage by one of the following methods:

(a) Each fitting shall be pressurized with air or other compressed gas at 60 psi (410 kPa) while under water for a minimum duration of 5 sec.

(b) Each fitting shall be hydrostatically tested with water at 250 psi (1 720 kPa) for a minimum duration of 15 sec.

www.fouladline.com

Table 3.1-1 Internal Pressure–Temperature Ratings for Cast Copper Alloy Fittings, psi (kPa)

Standard Water Tube Size	–20°F to 100°F (–29°C to 38°C)	150°F (66°C)	200°F (93°C)	250°F (121°C)	300°F (149°C)	350°F (177°C)	400°F (204°C)
1/4	910 (6 280)	770 (5 340)	745 (5 130)	725 (5 020)	710 (4 920)	605 (4 190)	455 (3 140)
3/8	775 (5 360)	660 (4 560)	635 (4 380)	620 (4 290)	610 (4 200)	515 (3 570)	385 (2 680)
1/2	720 (4 970)	610 (4 220)	585 (4 060)	575 (3 980)	565 (3 890)	480 (3 310)	360 (2 480)
5/8	630 (4 350)	535 (3 700)	515 (3 550)	505 (3 480)	490 (3 410)	420 (2 900)	315 (2 170)
3/4	580 (4 010)	490 (3 410)	475 (3 270)	465 (3 210)	455 (3 140)	385 (2 670)	290 (2 000)
1	490 (3 400)	420 (2 890)	400 (2 780)	395 (2 720)	385 (2 660)	325 (2 270)	245 (1 700)
1 1/4	435 (3 020)	370 (2 570)	355 (2 470)	350 (2 420)	340 (2 370)	290 (2 010)	215 (1 510)
1 1/2	405 (2 810)	345 (2 390)	330 (2 300)	325 (2 250)	315 (2 200)	270 (1 870)	200 (1 400)
2	360 (2 500)	305 (2 130)	295 (2 040)	290 (2 000)	280 (1 960)	240 (1 670)	180 (1 250)
2 1/2	335 (2 310)	285 (1 960)	270 (1 890)	265 (1 850)	260 (1 810)	220 (1 540)	165 (1 150)
3	315 (2 180)	265 (1 850)	255 (1 780)	250 (1 740)	245 (1 710)	210 (1 450)	155 (1 090)
3 1/2	300 (2 090)	255 (1 770)	245 (1 700)	240 (1 670)	235 (1 630)	200 (1 390)	150 (1 040)
4	290 (2 020)	245 (1 710)	240 (1 650)	230 (1 610)	225 (1 580)	195 (1 340)	145 (1 010)
5	265 (1 850)	225 (1 570)	220 (1 510)	215 (1 480)	210 (1 450)	175 (1 230)	130 (920)
6	250 (1 720)	210 (1 460)	205 (1 420)	200 (1 380)	195 (1 350)	165 (1 150)	125 (860)
8	270 (1 860)	225 (1 580)	220 (1 520)	215 (1 490)	210 (1 460)	180 (1 240)	135 (930)
10	270 (1 860)	230 (1 580)	220 (1 520)	215 (1 490)	210 (1 460)	180 (1 240)	135 (930)
12	250 (1 740)	215 (1 480)	205 (1 420)	200 (1 390)	195 (1 360)	165 (1 160)	125 (870)

GENERAL NOTES:

- (a) For size designation of fittings, see [section 4](#).
- (b) The internal pressure rating applies to the largest opening of the fitting.
- (c) The internal pressure rating is calculated, as shown in [Nonmandatory Appendix B](#), then rounded down to the nearest unit of 5 for psi and 10 for kPa.

Figure 4-1 Method of Designating Openings of Fittings

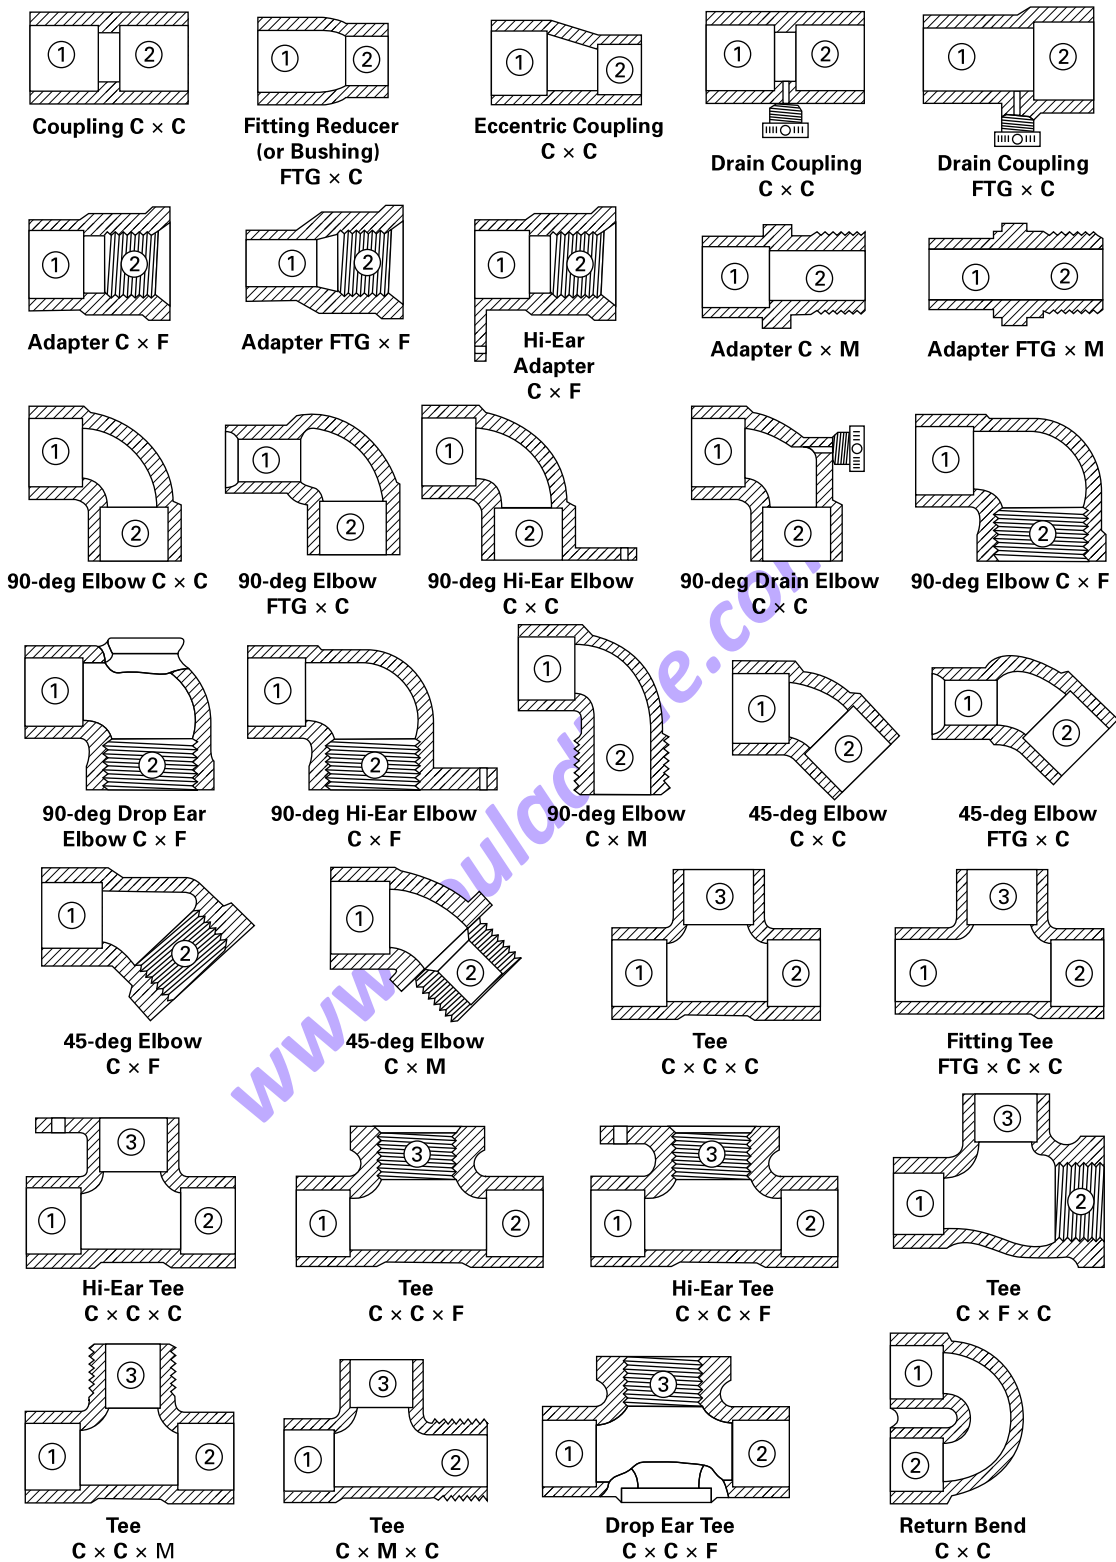
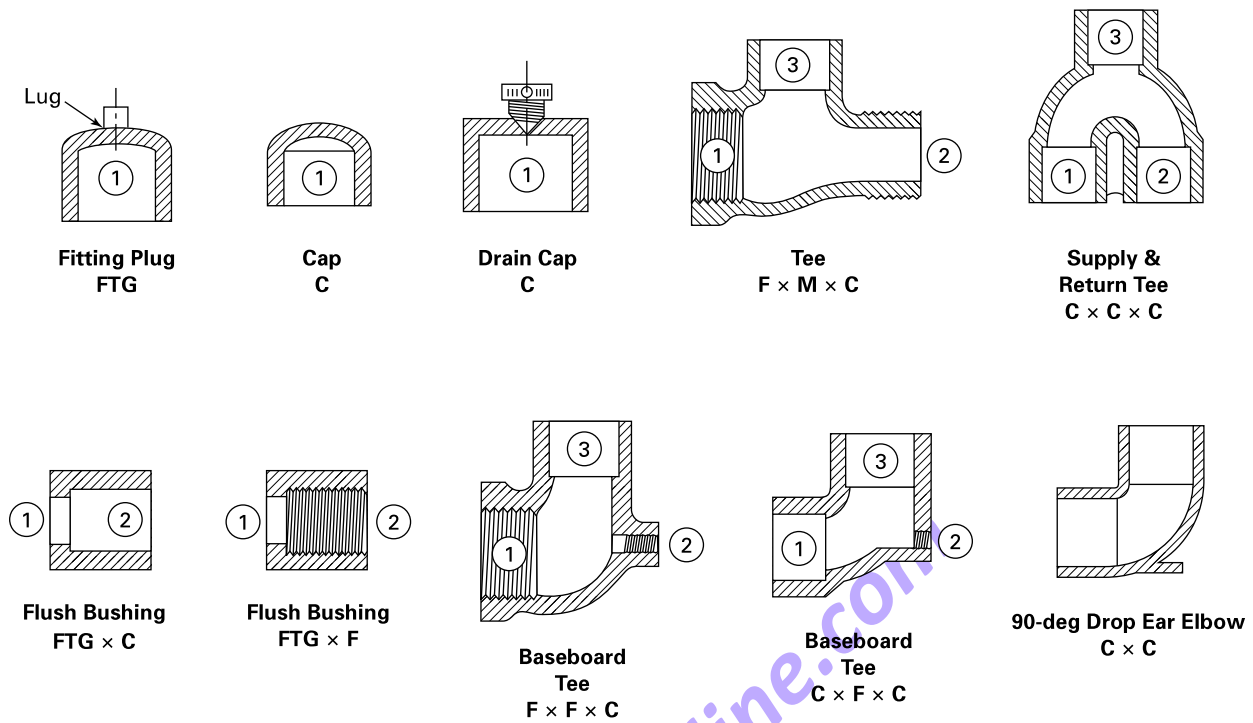



Figure 4-1 Method of Designating Openings of Fittings (Cont'd)

GENERAL NOTE: Fittings are designated by size in the order shown — i.e., 1 × 2 × 3.

Table 8.2-1 Inspection Tolerances

Standard Water Tube and Pipe Thread Size	Plus or Minus in. (mm)
$\frac{1}{4}$, $\frac{3}{8}$	0.05 (1.3)
$\frac{1}{2}$, $\frac{3}{4}$	0.06 (1.5)
1 to 2 incl.	0.08 (2.0)
$2\frac{1}{2}$ to $3\frac{1}{2}$ incl.	0.11 (2.8)
4, 5	0.12 (3.2)
6, 8	0.16 (4.0)
10, 12	0.20 (5.2)

Table 8.2-2 Dimensions of Solder Joint Ends

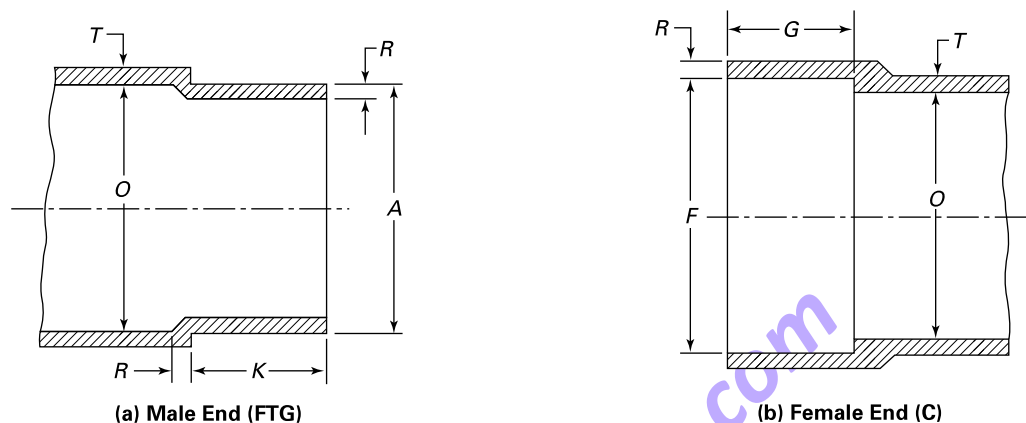


Standard Water Tube Size [Note (1)]	Male End			Female End			Metal Thickness [Note (3)], in. (mm)		Minimum Inside Diameter of Fitting O, in. (mm)
	Outside Diameter [Note (2)], A, in. (mm)		Minimum Length, K, in. (mm)	Inside Diameter, F, in. (mm)		Minimum Depth, G, in. (mm)			
	Min.	Max.		Min.	Max.				
1/4	0.373 (9.47)	0.376 (9.55)	0.38 (9.5)	0.377 (9.58)	0.381 (9.68)	0.31 (8.0)	0.08 (2.0)	0.05 (1.3)	0.31 (7.9)
3/8	0.497 (12.62)	0.501 (12.73)	0.44 (11.0)	0.502 (12.75)	0.506 (12.85)	0.38 (9.5)	0.09 (2.3)	0.05 (1.3)	0.43 (10.9)
1/2	0.622 (15.80)	0.626 (15.90)	0.56 (14.5)	0.627 (15.93)	0.631 (16.03)	0.50 (12.5)	0.09 (2.3)	0.05 (1.3)	0.54 (13.7)
3/4	0.872 (22.15)	0.876 (22.25)	0.81 (20.5)	0.877 (22.28)	0.881 (22.38)	0.75 (19.0)	0.10 (2.5)	0.06 (1.5)	0.78 (19.8)
1	1.122 (28.50)	1.127 (28.63)	0.97 (24.5)	1.128 (28.65)	1.132 (28.75)	0.91 (23.0)	0.11 (2.8)	0.07 (1.8)	1.02 (25.9)
1 1/4	1.372 (34.85)	1.377 (34.98)	1.03 (26.0)	1.378 (35.00)	1.382 (35.10)	0.97 (24.5)	0.12 (3.0)	0.07 (1.8)	1.26 (32.0)
1 1/2	1.621 (41.17)	1.627 (41.33)	1.16 (29.5)	1.628 (41.35)	1.633 (41.48)	1.09 (28.0)	0.13 (3.3)	0.08 (2.0)	1.50 (38.1)
2	2.121 (53.87)	2.127 (54.03)	1.41 (35.5)	2.128 (54.05)	2.133 (54.18)	1.34 (34.0)	0.15 (3.8)	0.09 (2.3)	1.98 (50.3)
2 1/2	2.621 (66.57)	2.627 (66.73)	1.53 (39.0)	2.628 (66.75)	2.633 (66.88)	1.47 (37.5)	0.17 (4.3)	0.10 (2.5)	2.46 (62.5)
3	3.121 (79.27)	3.127 (79.43)	1.72 (43.5)	3.128 (79.45)	3.133 (79.58)	1.66 (42.0)	0.19 (4.8)	0.11 (2.8)	2.94 (74.7)
3 1/2	3.621 (91.97)	3.627 (92.13)	1.97 (50.0)	3.628 (92.15)	3.633 (92.28)	1.91 (48.5)	0.20 (5.1)	0.12 (3.0)	3.42 (86.9)
4	4.121 (104.67)	4.127 (104.83)	2.22 (56.5)	4.128 (104.85)	4.133 (104.98)	2.16 (55.0)	0.22 (5.6)	0.13 (3.3)	3.90 (99.1)
5	5.121 (130.07)	5.127 (130.23)	2.72 (69.0)	5.128 (130.25)	5.133 (130.38)	2.66 (67.5)	0.28 (7.1)	0.17 (4.3)	4.87 (123.7)
6	6.121 (155.47)	6.127 (155.63)	3.22 (82.0)	6.128 (155.65)	6.133 (155.78)	3.09 (78.5)	0.34 (8.6)	0.20 (5.1)	5.84 (148.3)
8	8.119 (206.22)	8.127 (206.43)	4.09 (104.0)	8.128 (206.45)	8.133 (206.58)	3.97 (101.0)	0.38 (9.5)	0.31 (7.9)	7.72 (196.1)
10	10.119 (257.02)	10.127 (257.23)	4.12 (104.6)	10.128 (257.25)	10.133 (257.38)	4.00 (101.6)	0.48 (12.2)	0.48 (12.2)	9.62 (244.3)
12	12.119 (307.82)	12.127 (308.03)	4.62 (117.3)	12.128 (308.05)	12.133 (308.18)	4.50 (114.3)	0.56 (14.2)	0.56 (14.2)	11.56 (293.6)

GENERAL NOTE: The sketches and designs of fittings are illustrative only. Dimensions herein shall govern in all cases.

NOTES:

- (1) For size designation of fitting, see [section 4](#).
- (2) For ovality and gaging tolerances, see [section 8](#).
- (3) For metal thickness, see [section 7](#).

Table 8.2-3 Dimensions of Couplings

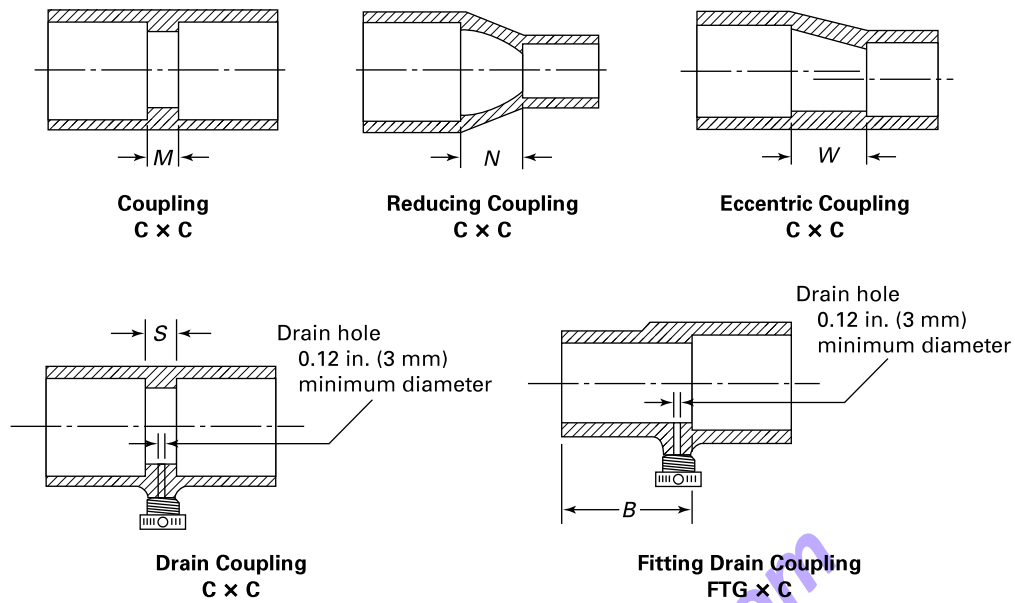


Straight		Reducing		Eccentric		Drain	
Standard Water Tube Size [Note (1)]	Laying Length [Note (2)], M, in. (mm)	Standard Water Tube Size [Note (1)]	Laying Length [Note (2)], N, in. (mm)	Standard Water Tube Size [Note (1)]	Laying Length [Note (2)], W, in. (mm)	Laying Length [Note (2)], S, in. (mm)	Laying Length [Note (2)], B, in. (mm)
1/4	0.06 (1.5)	3/4 × 1/2	0.31 (8.0)	3/4 × 1/2	0.62 (16.0)	0.25 (6.5)	...
3/8	0.06 (1.5)	1 × 3/4	0.38 (9.5)	1 × 3/4	0.69 (17.5)	0.25 (6.5)	...
1/2	0.12 (3.0)	1 1/4 × 1	0.38 (9.5)	1 1/4 × 1	0.75 (19.0)	0.25 (6.5)	1.00 (25.5)
3/4	0.12 (3.0)	1 1/4 × 3/4	0.38 (9.5)	1 1/4 × 3/4	0.75 (19.0)	0.25 (6.5)	1.28 (32.5)
1	0.12 (3.0)	1 1/2 × 1 1/4	0.38 (9.5)	1 1/2 × 1 1/4	0.69 (17.5)	0.25 (6.5)	...
1 1/4	0.12 (3.0)	1 1/2 × 1	0.38 (9.5)	1 1/2 × 1	0.69 (17.5)	0.25 (6.5)	...
1 1/2	0.12 (3.0)	1 1/2 × 3/4	0.44 (11.0)	2 × 1 1/2	1.12 (28.5)	0.25 (6.5)	...
2	0.19 (4.5)	2 × 1 1/2	0.50 (12.5)	2 × 1 1/4	0.94 (24.0)	0.25 (6.5)	...
2 1/2	0.19 (4.5)	2 × 1 1/4	0.50 (12.5)	2 1/2 × 2	1.19 (30.0)
3	0.19 (4.5)	2 × 1	0.50 (12.5)	3 × 2 1/2	1.25 (32.0)
3 1/2	0.25 (6.5)	2 × 3/4	0.50 (12.5)	3 × 2	1.31 (33.5)
4	0.25 (6.5)	2 1/2 × 2	0.56 (14.5)	4 × 3	2.00 (51.0)
5	0.25 (6.5)	2 1/2 × 1 1/2	0.56 (14.5)
6	0.25 (6.5)	2 1/2 × 1 1/4	0.62 (16.0)
8	0.62 (16.0)	2 1/2 × 1	0.62 (16.0)
...	...	3 × 2 1/2	0.62 (16.0)
...	...	3 × 2	0.62 (16.0)
...	...	4 × 3	0.69 (17.5)
...	...	4 × 2 1/2	1.12 (28.5)
...	...	4 × 2	1.19 (30.0)
...	...	6 × 4	1.31 (33.5)
...	...	8 × 6	1.38 (35.0)

GENERAL NOTE: For dimensions not given in this Table, see Table 8.2-2.

NOTES:

(1) For size designation of fitting, see section 4.

(2) For inspection tolerances, see section 8 and Table 8.2-1.

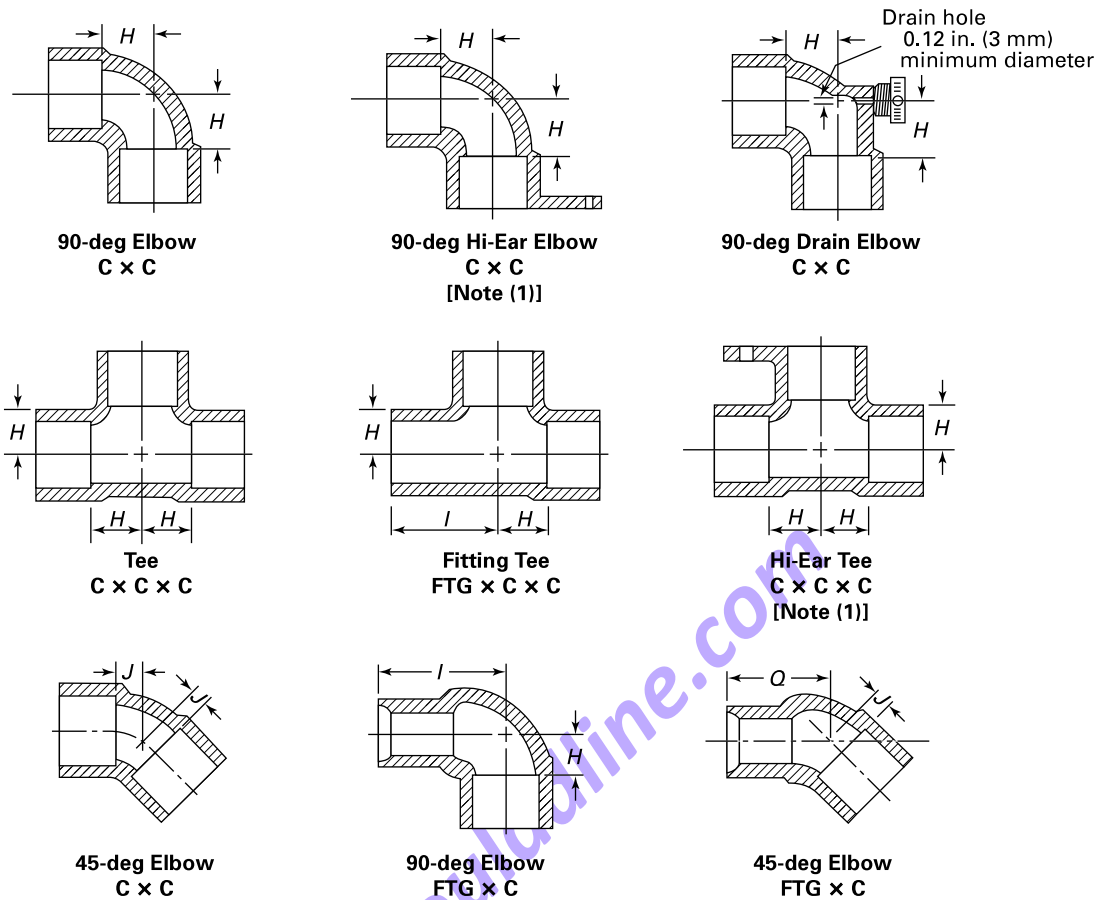
Table 8.2-4 Dimensions of Elbows, Tees, and 45-deg Elbows

Standard Water Tube Size [Note (2)]	Laying Length Tee and 90-deg Elbow [Note (3)], H, in. (mm)	Center-to-End 90-deg Elbow and Tee [Note (3)], I, in. (mm)	Laying Length 45-deg Elbow [Note (3)], J, in. (mm)	Center-to-End 45-deg Elbow [Note (3)], Q, in. (mm)
1/4	0.25 (6.5)	0.75 (19.0)
3/8	0.31 (8.0)	0.88 (22.0)	0.19 (5.0)	0.75 (19.0)
1/2	0.44 (11.0)	1.12 (28.5)	0.19 (5.0)	0.88 (22.0)
3/4	0.56 (14.5)	1.50 (38.0)	0.25 (6.5)	1.19 (30.0)
1	0.75 (19.0)	1.84 (47.0)	0.31 (8.0)	1.31 (33.5)
1 1/4	0.88 (22.0)	2.03 (51.5)	0.44 (11.0)	1.56 (39.5)
1 1/2	1.00 (25.5)	2.28 (58.0)	0.50 (12.5)	1.75 (44.5)
2	1.25 (32.0)	2.78 (70.5)	0.56 (14.5)	2.12 (54.0)
2 1/2	1.50 (38.0)	3.16 (80.0)	0.62 (16.0)	...
3	1.75 (44.5)	3.59 (91.5)	0.75 (19.0)	...
3 1/2	2.00 (51.0)	...	0.88 (22.0)	...
4	2.25 (57.0)	4.59 (116.5)	0.94 (24.0)	...
5	3.12 (79.5)	...	1.44 (36.5)	...
6	3.62 (92.0)	...	1.62 (41.5)	...
8	4.88 (124.0)	...	2.12 (54.0)	...

GENERAL NOTE: For dimensions not given in this Table, see [Table 8.2-2](#).

NOTES:

- (1) Hi-ear fittings are designed for use with 9/16 in. (14 mm) maximum width strap.
- (2) For size designation of fitting, see [section 4](#).
- (3) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

Table 8.2-5 Dimensions of Reducing 90-deg Elbows**90-deg Elbow
C × C**

Standard Water Tube Size [Note (1)]	Laying Length [Note (2)]	
	X, in. (mm)	Z, in. (mm)
$\frac{3}{8} \times \frac{1}{4}$	0.25 (6.5)	0.31 (8.0)
$\frac{1}{2} \times \frac{3}{8}$	0.38 (9.5)	0.44 (11.0)
$\frac{3}{4} \times \frac{1}{2}$	0.44 (11.0)	0.56 (14.5)
$1 \times \frac{3}{4}$	0.62 (16.0)	0.75 (19.0)
$1 \times \frac{1}{2}$	0.50 (12.5)	0.75 (19.0)
$1\frac{1}{4} \times 1$	0.75 (19.0)	0.88 (22.0)
$1\frac{1}{4} \times \frac{3}{4}$	0.62 (16.0)	0.88 (22.0)
$1\frac{1}{4} \times \frac{1}{2}$	0.50 (12.5)	0.88 (22.0)
$1\frac{1}{2} \times 1\frac{1}{4}$	0.88 (22.0)	1.00 (25.5)
$1\frac{1}{2} \times 1$	0.75 (19.0)	1.00 (25.5)
$1\frac{1}{2} \times \frac{3}{4}$	0.62 (16.0)	1.00 (25.5)
$2 \times 1\frac{1}{2}$	1.00 (25.5)	1.25 (31.5)
$2 \times 1\frac{1}{4}$	0.88 (22.0)	1.25 (31.5)
2×1	0.75 (19.0)	1.25 (31.5)
$2 \times \frac{3}{4}$	0.62 (16.0)	1.25 (31.5)
$2\frac{1}{2} \times 2$	1.25 (31.5)	1.50 (38.0)
$2\frac{1}{2} \times 1\frac{1}{2}$	1.00 (25.5)	1.50 (38.0)
$2\frac{1}{2} \times 1\frac{1}{4}$	0.88 (22.0)	1.50 (38.0)
$2\frac{1}{2} \times 1$	0.75 (19.0)	1.50 (38.0)
$3 \times 2\frac{1}{2}$	1.50 (38.0)	1.75 (44.5)
3×2	1.25 (31.5)	1.75 (44.5)
$3 \times 1\frac{1}{2}$	1.00 (25.5)	1.75 (44.5)
$3 \times 1\frac{1}{4}$	0.88 (22.0)	1.75 (44.5)
4×3	1.75 (44.5)	2.25 (57.0)
$4 \times 2\frac{1}{2}$	1.50 (38.0)	2.25 (57.0)
4×2	1.25 (31.5)	2.25 (57.0)
6×4	2.62 (66.5)	3.62 (92.0)
6×3	2.00 (51.0)	3.62 (92.0)
8×6	3.88 (98.5)	4.88 (124.0)


GENERAL NOTE: For dimensions not given in this Table, see [Table 8.2-2](#).

NOTES:

(1) For size designation of fitting, see [section 4](#).

(2) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

Table 8.2-6 Dimensions of Reducing Tees

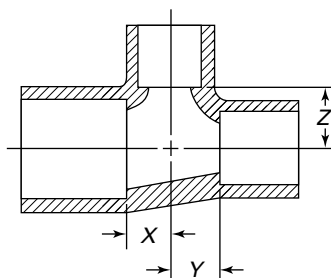

Tee
C x C x C

Standard Water Tube Size [Note (1)]	Laying Length [Note (2)]			Standard Water Tube Size [Note (1)]	Laying Length [Note (2)]		
	X, in. (mm)	Y, in. (mm)	Z, in. (mm)		X, in. (mm)	Y, in. (mm)	Z, in. (mm)
$\frac{3}{8} \times \frac{3}{8} \times \frac{1}{2}$	0.44 (11.0)	0.44 (11.0)	0.38 (9.5)	$1\frac{1}{4} \times 1 \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	0.88 (22.0)
$\frac{3}{8} \times \frac{3}{8} \times \frac{1}{4}$	0.25 (6.5)	0.25 (6.5)	0.31 (8.0)	$1\frac{1}{4} \times 1 \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	0.88 (22.0)
$\frac{1}{2} \times \frac{1}{2} \times \frac{3}{4}$	0.56 (14.5)	0.56 (14.5)	0.44 (11.0)	$1\frac{1}{4} \times \frac{3}{4} \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	0.88 (22.0)
$\frac{1}{2} \times \frac{1}{2} \times \frac{3}{8}$	0.38 (9.5)	0.38 (9.5)	0.44 (11.0)	$1\frac{1}{4} \times \frac{3}{4} \times 1$	0.75 (19.0)	0.75 (19.0)	0.88 (22.0)
$\frac{1}{2} \times \frac{1}{2} \times \frac{1}{4}$	0.31 (8.0)	0.31 (8.0)	0.44 (11.0)	$1\frac{1}{4} \times \frac{3}{4} \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	0.88 (22.0)
$\frac{1}{2} \times \frac{3}{8} \times \frac{1}{2}$	0.44 (11.0)	0.44 (11.0)	0.44 (11.0)	$1\frac{1}{4} \times \frac{1}{2} \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	0.88 (22.0)
$\frac{1}{2} \times \frac{3}{8} \times \frac{3}{8}$	0.38 (9.5)	0.38 (9.5)	0.44 (11.0)	$1\frac{1}{4} \times \frac{1}{2} \times 1$	0.75 (19.0)	0.75 (19.0)	0.88 (22.0)
$\frac{3}{4} \times \frac{3}{4} \times 1$	0.75 (19.0)	0.75 (19.0)	0.62 (16.0)	$1\frac{1}{2} \times 1\frac{1}{2} \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.00 (25.5)
$\frac{3}{4} \times \frac{3}{4} \times \frac{1}{2}$	0.44 (11.0)	0.44 (11.0)	0.56 (14.5)	$1\frac{1}{2} \times 1\frac{1}{2} \times 2$	1.25 (32.0)	1.25 (32.0)	1.00 (25.5)
$\frac{3}{4} \times \frac{3}{4} \times \frac{3}{8}$	0.38 (9.5)	0.38 (9.5)	0.56 (14.5)	$1\frac{1}{2} \times 1\frac{1}{2} \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.00 (25.5)
$\frac{3}{4} \times \frac{1}{2} \times \frac{3}{4}$	0.56 (14.5)	0.56 (14.5)	0.56 (14.5)	$1\frac{1}{2} \times 1\frac{1}{2} \times 1$	0.75 (19.0)	0.75 (19.0)	1.00 (25.5)
$\frac{3}{4} \times \frac{1}{2} \times \frac{1}{2}$	0.44 (11.0)	0.44 (11.0)	0.56 (14.5)	$1\frac{1}{2} \times 1\frac{1}{2} \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	1.00 (25.5)
$\frac{3}{4} \times \frac{1}{2} \times \frac{3}{8}$	0.38 (9.5)	0.38 (9.5)	0.56 (14.5)	$1\frac{1}{2} \times 1\frac{1}{2} \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	1.00 (25.5)
$1 \times 1 \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	0.75 (19.0)	$1\frac{1}{2} \times 1\frac{1}{4} \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.00 (25.5)
$1 \times 1 \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	0.75 (19.0)	$1\frac{1}{2} \times 1\frac{1}{4} \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.00 (25.0)
$1 \times 1 \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	0.75 (19.0)	$1\frac{1}{2} \times 1\frac{1}{4} \times 1$	0.75 (19.0)	0.75 (19.0)	1.00 (25.5)
$1 \times 1 \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	0.75 (19.0)	$1\frac{1}{2} \times 1\frac{1}{4} \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	1.00 (25.0)
$1 \times 1 \times \frac{3}{8}$	0.44 (11.0)	0.44 (11.0)	0.75 (19.0)	$1\frac{1}{2} \times 1\frac{1}{4} \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	1.00 (25.5)
$1 \times \frac{3}{4} \times 1$	0.75 (19.0)	0.75 (19.0)	0.75 (19.0)	$1\frac{1}{2} \times 1 \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.00 (25.5)
$1 \times \frac{3}{4} \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	0.75 (19.0)	$1\frac{1}{2} \times 1 \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.00 (25.5)
$1 \times \frac{3}{4} \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	0.75 (19.0)	$1\frac{1}{2} \times 1 \times 1$	0.75 (19.0)	0.75 (19.0)	1.00 (25.5)
$1 \times \frac{1}{2} \times 1$	0.75 (19.0)	0.75 (19.0)	0.75 (19.0)	$1\frac{1}{2} \times \frac{3}{4} \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.00 (25.5)
$1 \times \frac{1}{2} \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	0.75 (19.0)	$1\frac{1}{2} \times \frac{1}{2} \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.00 (25.5)
$1 \times \frac{1}{2} \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	0.75 (19.0)	$2 \times 2 \times 4$	2.25 (57.0)	2.25 (57.0)	1.25 (32.0)
$1\frac{1}{4} \times 1\frac{1}{4} \times 2$	1.25 (32.0)	1.25 (32.0)	0.88 (22.0)	$2 \times 2 \times 3$	1.75 (44.5)	1.75 (44.5)	1.25 (32.0)
$1\frac{1}{4} \times 1\frac{1}{4} \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	0.88 (22.0)	$2 \times 2 \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.25 (32.0)
$1\frac{1}{4} \times 1\frac{1}{4} \times 1$	0.75 (19.0)	0.75 (19.0)	0.88 (22.0)	$2 \times 2 \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.25 (32.0)
$1\frac{1}{4} \times 1\frac{1}{4} \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	0.88 (22.0)	$2 \times 2 \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.25 (32.0)
$1\frac{1}{4} \times 1\frac{1}{4} \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	0.88 (22.0)	$2 \times 2 \times 1$	0.75 (19.0)	0.75 (19.0)	1.25 (32.0)
$1\frac{1}{4} \times 1 \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	0.88 (22.0)	$2 \times 2 \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	1.25 (32.0)
$1\frac{1}{4} \times 1 \times 1$	0.75 (19.0)	0.75 (19.0)	0.88 (22.0)	$2 \times 2 \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	1.25 (32.0)

Table 8.2-6 Dimensions of Reducing Tees (Cont'd)

Standard Water Tube Size [Note (1)]	Laying Length [Note (2)]			Standard Water Tube Size [Note (1)]	Laying Length [Note (2)]		
	X, in. (mm)	Y, in. (mm)	Z, in. (mm)		X, in. (mm)	Y, in. (mm)	Z, in. (mm)
$2 \times 1\frac{1}{2} \times 2$	1.25 (32.0)	1.25 (32.0)	1.25 (32.0)	$3 \times 3 \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	1.75 (44.5)
$2 \times 1\frac{1}{2} \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.25 (32.0)	$3 \times 3 \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	1.75 (44.5)
$2 \times 1\frac{1}{2} \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.25 (32.0)	$3 \times 2\frac{1}{2} \times 3$	1.75 (44.5)	1.75 (44.5)	1.75 (44.5)
$2 \times 1\frac{1}{2} \times 1$	0.75 (19.0)	0.75 (19.0)	1.25 (32.0)	$3 \times 2\frac{1}{2} \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.75 (44.5)
$2 \times 1\frac{1}{2} \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	1.25 (32.0)	$3 \times 2\frac{1}{2} \times 2$	1.25 (32.0)	1.25 (32.0)	1.75 (44.5)
$2 \times 1\frac{1}{2} \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	1.25 (32.0)	$3 \times 2\frac{1}{2} \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.75 (44.5)
$2 \times 1\frac{1}{4} \times 2$	1.25 (32.0)	1.25 (32.0)	1.25 (32.0)	$3 \times 2\frac{1}{2} \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.75 (44.5)
$2 \times 1\frac{1}{4} \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.25 (32.0)	$3 \times 2\frac{1}{2} \times 1$	0.75 (19.0)	0.75 (19.0)	1.75 (44.5)
$2 \times 1\frac{1}{4} \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.25 (32.0)	$3 \times 2 \times 3$	1.75 (44.5)	1.75 (44.5)	1.75 (44.5)
$2 \times 1 \times 2$	1.25 (32.0)	1.25 (32.0)	1.25 (32.0)	$3 \times 2 \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.75 (44.5)
$2 \times \frac{3}{4} \times 2$	1.25 (32.0)	1.25 (32.0)	1.25 (32.0)	$3 \times 2 \times 2$	1.25 (32.0)	1.25 (32.0)	1.75 (44.5)
$2 \times \frac{1}{2} \times 2$	1.25 (32.0)	1.25 (32.0)	1.25 (32.0)	$3 \times 2 \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.75 (44.5)
$2\frac{1}{2} \times 2\frac{1}{2} \times 4$	2.25 (57.0)	2.25 (57.0)	1.50 (38.0)	$3 \times 1\frac{1}{2} \times 3$	1.75 (44.5)	1.75 (44.5)	1.75 (44.5)
$2\frac{1}{2} \times 2\frac{1}{2} \times 3$	1.75 (44.5)	1.75 (44.5)	1.50 (38.0)	$3 \times 1\frac{1}{4} \times 3$	1.75 (44.5)	1.75 (44.5)	1.75 (44.5)
$2\frac{1}{2} \times 2\frac{1}{2} \times 2$	1.25 (32.0)	1.25 (32.0)	1.50 (38.0)	$3 \times 1 \times 3$	1.75 (44.5)	1.75 (44.5)	1.75 (44.5)
$2\frac{1}{2} \times 2\frac{1}{2} \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.50 (38.0)	$3\frac{1}{2} \times 3\frac{1}{2} \times 3$	1.75 (44.5)	1.75 (44.5)	2.00 (51.0)
$2\frac{1}{2} \times 2\frac{1}{2} \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.50 (38.0)	$3\frac{1}{2} \times 3 \times 3\frac{1}{2}$	2.00 (51.0)	2.00 (51.0)	2.00 (51.0)
$2\frac{1}{2} \times 2\frac{1}{2} \times 1$	0.75 (19.0)	0.75 (19.0)	1.50 (38.0)	$4 \times 4 \times 6$	3.62 (92.0)	3.62 (92.0)	2.62 (66.0)
$2\frac{1}{2} \times 2\frac{1}{2} \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	1.50 (38.0)	$4 \times 4 \times 3$	1.75 (44.5)	1.75 (44.5)	2.25 (57.0)
$2\frac{1}{2} \times 2\frac{1}{2} \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	1.50 (38.0)	$4 \times 4 \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	2.25 (57.0)
$2\frac{1}{2} \times 2 \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.50 (38.0)	$4 \times 4 \times 2$	1.25 (32.0)	1.25 (32.0)	2.25 (57.0)
$2\frac{1}{2} \times 2 \times 2$	1.25 (32.0)	1.25 (32.0)	1.50 (38.0)	$4 \times 4 \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	2.25 (57.0)
$2\frac{1}{2} \times 2 \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.50 (38.0)	$4 \times 4 \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	2.25 (57.0)
$2\frac{1}{2} \times 2 \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.50 (38.0)	$4 \times 4 \times 1$	0.75 (19.0)	0.75 (19.0)	2.25 (57.0)
$2\frac{1}{2} \times 2 \times 1$	0.75 (19.0)	0.75 (19.0)	1.50 (38.0)	$4 \times 4 \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	2.25 (57.0)
$2\frac{1}{2} \times 2 \times \frac{3}{4}$	0.62 (16.0)	0.62 (16.0)	1.50 (38.0)	$4 \times 3 \times 4$	2.25 (57.0)	2.25 (57.0)	2.25 (57.0)
$2\frac{1}{2} \times 2 \times \frac{1}{2}$	0.50 (12.5)	0.50 (12.5)	1.50 (38.0)	$4 \times 3 \times 3$	1.75 (44.5)	1.75 (44.5)	2.25 (57.0)
$2\frac{1}{2} \times 1\frac{1}{2} \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.50 (38.0)	$4 \times 3 \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	2.25 (57.0)
$2\frac{1}{2} \times 1\frac{1}{2} \times 2$	1.25 (32.0)	1.25 (32.0)	1.50 (38.0)	$4 \times 3 \times 2$	1.25 (32.0)	1.25 (32.0)	2.25 (57.0)
$2\frac{1}{2} \times 1\frac{1}{2} \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.50 (38.0)	$4 \times 2\frac{1}{2} \times 4$	2.25 (57.0)	2.25 (57.0)	2.25 (57.0)
$2\frac{1}{2} \times 1\frac{1}{4} \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.50 (38.0)	$4 \times 2 \times 4$	2.25 (57.0)	2.25 (57.0)	2.25 (57.0)
$2\frac{1}{2} \times 1 \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.50 (38.0)	$4 \times 2 \times 3$	1.75 (44.5)	1.75 (44.5)	2.25 (57.0)
$2\frac{1}{2} \times \frac{3}{4} \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.50 (38.0)	$4 \times 2 \times 2$	1.25 (32.0)	1.25 (32.0)	2.25 (57.0)
$2\frac{1}{2} \times \frac{1}{2} \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.50 (38.0)	$4 \times 1\frac{1}{2} \times 4$	2.25 (57.0)	2.25 (57.0)	2.25 (57.0)
$3 \times 3 \times 4$	2.25 (57.0)	2.25 (57.0)	1.75 (44.5)	$4 \times 1\frac{1}{4} \times 4$	2.25 (57.0)	2.25 (57.0)	2.25 (57.0)
$3 \times 3 \times 2\frac{1}{2}$	1.50 (38.0)	1.50 (38.0)	1.75 (44.5)	$4 \times 1 \times 4$	2.25 (57.0)	2.25 (57.0)	2.25 (57.0)
$3 \times 3 \times 2$	1.25 (32.0)	1.25 (32.0)	1.75 (44.5)	$5 \times 5 \times 4$	2.62 (66.0)	2.62 (66.0)	3.12 (79.5)
$3 \times 3 \times 1\frac{1}{2}$	1.00 (25.5)	1.00 (25.5)	1.75 (44.5)	$5 \times 4 \times 5$	3.12 (79.5)	3.12 (79.5)	3.12 (79.5)
$3 \times 3 \times 1\frac{1}{4}$	0.88 (22.0)	0.88 (22.0)	1.75 (44.5)	$6 \times 6 \times 8$	4.88 (124.0)	4.88 (124.0)	3.88 (98.5)
$3 \times 3 \times 1$	0.75 (19.0)	0.75 (19.0)	1.75 (44.5)	$6 \times 6 \times 4$	2.62 (66.5)	2.62 (66.5)	3.62 (92.0)


Table 8.2-6 Dimensions of Reducing Tees (Cont'd)

Standard Water Tube Size [Note (1)]	Laying Length [Note (2)]			Standard Water Tube Size [Note (1)]	Laying Length [Note (2)]		
	X, in. (mm)	Y, in. (mm)	Z, in. (mm)		X, in. (mm)	Y, in. (mm)	Z, in. (mm)
6 × 6 × 3	2.00 (50.5)	2.00 (50.5)	3.62 (92.0)	6 × 4 × 4	2.62 (66.5)	2.62 (66.5)	3.62 (92.0)
6 × 6 × 2½	1.88 (47.5)	1.88 (47.5)	3.62 (92.0)	6 × 3 × 6	3.62 (92.0)	3.62 (92.0)	3.62 (92.0)
6 × 6 × 2	1.62 (41.5)	1.62 (41.5)	3.62 (92.0)	6 × 2½ × 6	3.62 (92.0)	3.62 (92.0)	3.62 (92.0)
6 × 6 × 1½	1.38 (35.0)	1.38 (35.0)	3.62 (92.0)	6 × 2 × 6	3.62 (92.0)	3.62 (92.0)	3.62 (92.0)
6 × 6 × 1¼	1.25 (32.0)	1.25 (32.0)	3.62 (92.0)	8 × 8 × 6	3.88 (98.5)	3.88 (98.5)	4.88 (124.0)
6 × 6 × 1	1.12 (28.5)	1.12 (28.5)	3.62 (92.0)	8 × 8 × 4	2.88 (73.0)	2.88 (73.0)	4.88 (124.0)
6 × 4 × 6	3.62 (92.0)	3.62 (92.0)	3.62 (92.0)

GENERAL NOTE: For dimensions not given in this Table, see [Table 8.2-2](#).

NOTES:

- (1) For size designation of fitting, see [section 4](#).
(2) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

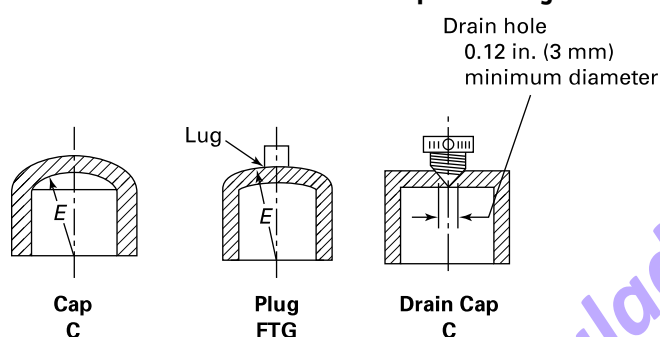Table 8.2-7 Dimensions of Caps and Plugs


Standard Water Tube Size [Note (1)]	Caps and Plugs, Radius [Note (2)], E, in. (mm)
¼	0.38 (9.5)
⅜	0.50 (12.5)
½	0.62 (16.0)
¾	0.88 (22.0)
1	1.12 (28.5)
1¼	1.38 (35.0)
1½	1.62 (41.5)
2	2.12 (54.0)
2½	2.62 (66.5)
3	3.12 (79.5)
3½	3.62 (92.0)
4	4.12 (105.0)
5	5.12 (130.0)
6	6.12 (155.5)

GENERAL NOTES:

- (a) For dimensions not given in this Table, see [Table 8.2-2](#).
(b) Casting of lug or square on plugs shall be optional.

NOTES:

- (1) For size designation of fitting, see [section 4](#).
(2) Caps may have either flat or rounded top.

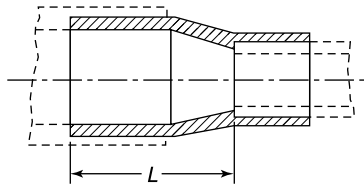Table 8.2-8 Dimensions of Fitting Reducers


**Fitting Reducer
(or Bushing)
FTG × C**

Standard Water Tube Size [Note (1)]	Length, L, in. (mm)
$\frac{3}{8} \times \frac{1}{4}$	0.69 (17.5)
$\frac{1}{2} \times \frac{3}{8}$	0.94 (24.0)
$\frac{1}{2} \times \frac{1}{4}$	0.94 (24.0)
$\frac{3}{4} \times \frac{1}{2}$	1.19 (30.0)
$\frac{3}{4} \times \frac{3}{8}$	1.25 (32.0)
$1 \times \frac{3}{4}$	1.50 (38.0)
$1 \times \frac{1}{2}$	1.50 (38.0)
$1\frac{1}{4} \times 1$	1.62 (41.5)
$1\frac{1}{4} \times \frac{3}{4}$	1.62 (41.5)
$1\frac{1}{4} \times 1\frac{1}{2}$	1.62 (41.5)
$1\frac{1}{2} \times 1\frac{1}{4}$	1.81 (46.0)
$1\frac{1}{2} \times 1$	1.81 (46.0)
$1\frac{1}{2} \times \frac{3}{4}$	1.81 (46.0)
$2 \times 1\frac{1}{2}$	2.12 (54.0)
$2 \times 1\frac{1}{4}$	2.12 (54.0)
2×1	2.12 (54.0)
$2\frac{1}{2} \times 2$	2.38 (60.5)
$2\frac{1}{2} \times 1\frac{1}{2}$	2.38 (60.5)
$2\frac{1}{2} \times 1\frac{1}{4}$	2.38 (60.5)
$3 \times 2\frac{1}{2}$	2.62 (66.5)
3×2	2.62 (66.5)
$3 \times 1\frac{1}{2}$	2.62 (66.5)
4×3	3.44 (87.5)
$4 \times 2\frac{1}{2}$	3.44 (87.5)
4×2	3.44 (87.5)

GENERAL NOTE: For dimensions not given in this Table, see [Table 8.2-2](#).

NOTE: (1) For size designation of fitting, see [section 4](#).

Table 8.2-9 Dimensions of Solder Joint Elbows and Tees With Pipe Thread Ends (Straight Sizes)

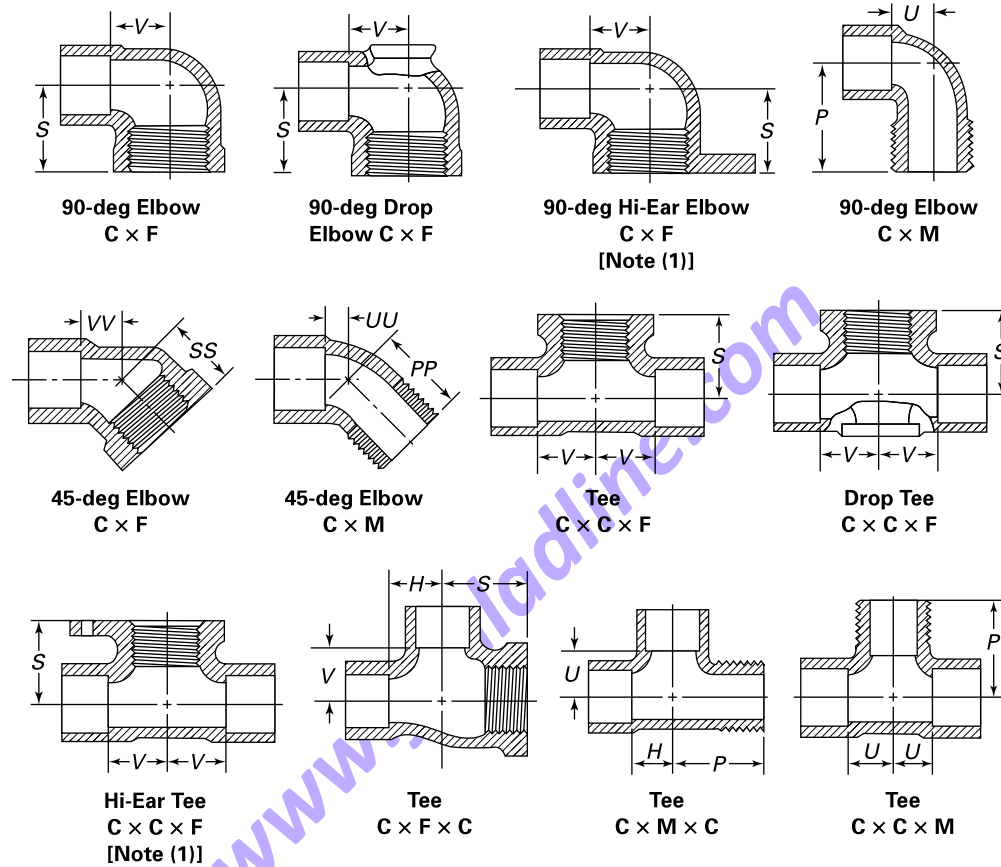

Standard Water Tube and Pipe Thread Size [Note (2)]	Internal Threads [Note (3)]					External Threads [Note (3)]				
	Center-to-End [Note (4)]		Laying Length [Note (4)]			Center-to-End [Note (4)]		Laying Length [Note (4)]		
	Elbow and Tee, S, in. (mm)	45-deg Elbow, SS, in. (mm)	Elbow and Tee, V, in. (mm)	Tee, H, in. (mm)	45-deg Elbow, VV, in. (mm)	Elbow and Tee, P, in. (mm)	45-deg Elbow, PP, in. (mm)	Elbow and Tee, U, in. (mm)	Tee, H, in. (mm)	45-deg Elbow, UU, in. (mm)
1/4	0.56 (14.5)	...	0.38 (9.5)	0.94 (24.0)	...	0.25 (6.5)
3/8	0.69 (17.5)	0.69 (17.5)	0.44 (11.0)	0.31 (8.0)	0.19 (4.5)	1.06 (27.0)	0.81 (20.5)	0.31 (8.0)	0.31 (8.0)	0.19 (4.5)
1/2	0.88 (22.0)	0.94 (24.0)	0.56 (14.5)	0.44 (11.0)	0.19 (4.5)	1.31 (33.5)	1.00 (25.5)	0.44 (11.0)	0.44 (11.0)	0.19 (4.5)
3/4	1.00 (25.5)	1.00 (25.5)	0.69 (17.5)	0.56 (14.5)	0.25 (6.5)	1.50 (38.0)	1.19 (30.0)	0.56 (14.5)	0.56 (14.5)	0.25 (6.5)
1	1.25 (32.0)	1.19 (30.0)	0.88 (22.0)	0.75 (19.0)	0.31 (8.0)	1.64 (41.5)	1.31 (33.5)	0.75 (19.0)	0.75 (19.0)	0.31 (8.0)
1 1/4	1.50 (38.0)	...	1.00 (25.5)	0.88 (22.0)	...	2.00 (51.0)	...	0.88 (22.0)
1 1/2	1.62 (41.5)	...	1.12 (28.5)	1.00 (25.5)	...	2.19 (55.5)	...	1.00 (25.5)

Table 8.2-9 Dimensions of Solder Joint Elbows and Tees With Pipe Thread Ends (Straight Sizes) (Cont'd)

Standard Water Tube and Pipe Thread Size [Note (2)]	Internal Threads [Note (3)]					External Threads [Note (3)]				
	Center-to-End [Note (4)]		Laying Length [Note (4)]			Center-to-End [Note (4)]		Laying Length [Note (4)]		
	Elbow and Tee, S, in. (mm)	45-deg Elbow, SS, in. (mm)	Elbow and Tee, V, in. (mm)	Tee, H, in. (mm)	45-deg Elbow, VV, in. (mm)	Elbow and Tee, P, in. (mm)	45-deg Elbow, PP, in. (mm)	Elbow and Tee, U, in. (mm)	Tee, H, in. (mm)	45-deg Elbow, UU, in. (mm)
2	1.94 (49.0)	...	1.38 (35.0)	1.25 (32.0)	...	2.62 (66.5)	...	1.25 (32.0)
2½	2.50 (63.5)	...	1.62 (41.5)
3	2.81 (71.5)	...	1.94 (49.0)
4	3.44 (87.5)	...	2.44 (62.0)
6	4.88 (124.0)	...	3.88 (98.5)


GENERAL NOTES:

- (a) For dimensions of threaded ends, see ASME B16.15. For configuration of threaded ends, see [section 10](#). For dimensions of solder joint ends, see [Table 8.2-2](#).
(b) For dimensions of reducing tees and elbows, see [Table 8.2-10](#).

NOTES:

- (1) Hi-ear fittings are designed for use with 9/16 in. (14 mm) maximum width strap.
(2) For size designation of fitting, see [section 4](#).
(3) For threads of threaded ends, see [section 9](#).
(4) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

Table 8.2-10 Dimensions of Solder Joint Elbows and Tees With Pipe Thread Ends (Reducing Sizes)

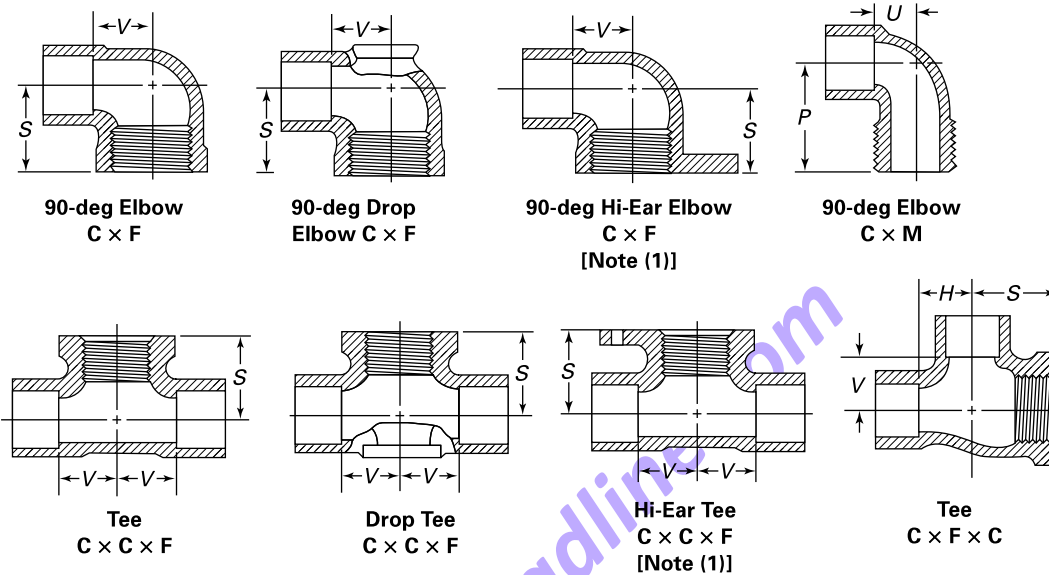

Standard Water Tube and Pipe Thread Size [Note (2)]	Internal Threads [Note (3)]							External Threads [Note (3)]	
	Center-to-End, S			Laying Length [Note (4)]				Center-to-End, P	Laying Length, U [Note (4)]
				V			H		
	90-deg Elbow C x F, in. (mm)	Tee C x C x F, in. (mm)	Tee C x F x C, in. (mm)	90-deg Elbow C x F, in. (mm)	Tee C x C x F, in. (mm)	Tee C x F x C, in. (mm)	Tee C x F x C, in. (mm)	90-deg Elbow C x M, in. (mm)	90-deg Elbow C x M, in. (mm)
$\frac{3}{8} \times \frac{3}{8} \times \frac{1}{2}$...	0.81 (20.5)	0.56 (14.5)
$\frac{3}{8} \times \frac{1}{2}$	0.81 (20.5)	0.56 (14.5)	1.25 (32.0)	0.44 (11.0)
$\frac{1}{2} \times \frac{1}{2} \times \frac{3}{4}$...	0.94 (23.5)	0.69 (17.5)
$\frac{1}{2} \times \frac{3}{4}$	0.94 (24.0)	0.69 (17.5)	1.38 (35.0)	0.56 (14.5)
$\frac{1}{2} \times \frac{1}{2} \times \frac{3}{8}$...	0.81 (20.5)	0.50 (12.5)
$\frac{1}{2} \times \frac{3}{8}$	0.81 (20.5)	0.50 (12.5)	1.12 (28.5)	0.31 (8.0)
$\frac{3}{4} \times \frac{3}{4} \times 1$...	1.12 (28.5)	0.88 (22.0)
$\frac{3}{4} \times 1$	1.12 (28.5)	0.88 (22.0)	1.69 (43.0)	0.75 (19.0)
$\frac{3}{4} \times \frac{3}{4} \times \frac{1}{2}$...	0.94 (24.0)	0.94 (24.0)	...	0.56 (14.5)	0.69 (17.5)	0.44 (11.0)
$\frac{3}{4} \times \frac{1}{2}$	0.94 (24.0)	0.56 (14.5)	1.44 (36.5)	0.44 (11.0)
$\frac{3}{4} \times \frac{3}{4} \times \frac{3}{8}$...	0.88 (22.0)	0.50 (12.5)
$\frac{3}{4} \times \frac{3}{8}$	0.88 (22.0)	0.50 (12.5)
$\frac{3}{4} \times \frac{1}{2} \times \frac{3}{4}$	0.94 (24.0)	0.56 (14.5)	0.56 (14.5)
$\frac{3}{4} \times \frac{1}{2} \times \frac{1}{2}$...	0.94 (24.0)	0.88 (22.0)	...	0.56 (14.5)	0.56 (14.5)	0.44 (11.0)


Table 8.2-10 Dimensions of Solder Joint Elbows and Tees With Pipe Thread Ends (Reducing Sizes) (Cont'd)

Standard Water Tube and Pipe Thread Size [Note (2)]	Internal Threads [Note (3)]							External Threads [Note (3)]	
	Center-to-End, <i>S</i>			Laying Length [Note (4)]				Center-to-End, <i>P</i>	Laying Length, <i>U</i> [Note (4)]
				<i>V</i>			<i>H</i>		
	90-deg Elbow C×F, in. (mm)	Tee C×C×F, in. (mm)	Tee C×F×C, in. (mm)	90-deg Elbow C×F, in. (mm)	Tee C×C×F, in. (mm)	Tee C×F×C, in. (mm)	Tee C×F×C, in. (mm)	90-deg Elbow C×M, in. (mm)	90-deg Elbow C×M, in. (mm)
1 × 1¼	1.38 (35.0)	1.00 (25.5)
1 × 1 × ¾	...	1.19 (30.0)	0.69 (17.5)
1 × ¾	1.19 (30.0)	0.69 (17.5)	1.62 (41.5)	0.56 (14.5)
1 × 1 × ½	...	1.12 (28.5)	0.56 (14.5)
1 × 1 × ⅜	...	1.06 (27.0)	0.50 (12.5)
1 × ¾ × 1	...	1.25 (32.0)	1.19 (30.0)	...	0.88 (22.0)	0.75 (19.0)	0.75 (19.0)
1 × ¾ × ¾	...	1.19 (30.0)	0.69 (17.5)
1 × ¾ × ½	...	1.12 (28.5)	0.56 (14.5)
1 × ½ × 1	1.12 (28.5)	0.75 (19.0)	0.75 (19.0)
1 × ½	1.12 (28.5)	0.56 (14.5)
1¼ × 1¼ × 1	...	1.44 (36.5)	0.88 (22.0)
1¼ × 1	1.44 (36.5)	0.88 (22.0)
1¼ × 1¼ × ¾	...	1.31 (33.5)	0.69 (17.5)
1¼ × 1¼ × ½	...	1.25 (32.0)	0.56 (14.5)
1¼ × 1¼ × ⅜	...	1.19 (30.0)	0.50 (12.5)
1¼ × ¾ × 1	1.19 (30.0)	0.88 (22.0)	0.75 (19.0)
1½ × 1½ × 1	...	1.50 (38.0)	1.38 (35.0)	...	0.88 (22.0)	1.12 (28.5)	0.75 (19.0)
1½ × 1½ × ¾	...	1.44 (36.5)	0.69 (17.5)
1½ × 1½ × ½	...	1.38 (35.0)	0.56 (14.5)
1½ × ¾ × 1	1.19 (30.0)	1.00 (25.5)	0.75 (19.0)
2 × 2 × 1½	...	1.88 (47.5)	1.12 (28.5)
2 × 2 × 1	...	1.75 (44.5)	0.88 (22.0)
2 × 2 × ¾	...	1.69 (43.0)	0.69 (17.5)
2 × 2 × ½	...	1.62 (41.5)	0.56 (14.5)
2½ × 2½ × ¾	...	2.06 (52.5)	0.69 (17.5)

GENERAL NOTE: For dimensions of threaded ends, see ASME B16.15. For configuration of threaded ends, see [section 10](#). For dimensions of solder joint ends, see [Table 8.2-2](#).

NOTES:

- (1) Hi-ear fittings are designed for use with ⁹/₁₆ in. (14 mm) maximum width strap.
- (2) For size designation of fitting, see [section 4](#).
- (3) For threads of threaded ends, see [section 9](#).
- (4) For inspection tolerance, see [section 8](#) and [Table 8.2-1](#).

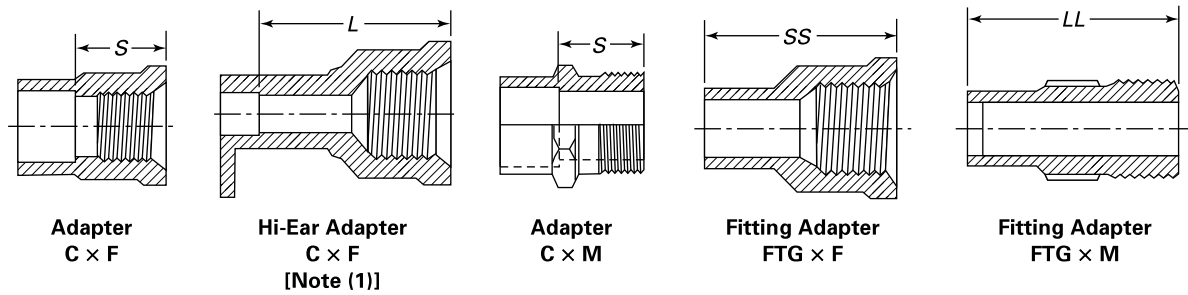Table 8.2-11 Dimensions of Solder Joint Adapters and Fitting Adapters With Pipe Thread Ends (Straight and Reducing Sizes)

Standard Water Tube and Pipe Thread Size [Note (2)]		Shoulder-to-End, S, in. (mm)	End-to-End		End-to-Tube Stop, L, in. (mm)
Solder Joint	Pipe Thread		SS, in. (mm)	LL, in. (mm)	
1/4	3/8	0.62 (16.0)
1/4	1/4	0.62 (16.0)	...	1.00 (25.5)	...
3/8	1/2	0.75 (19.0)	...	1.25 (32.0)	...
3/8	3/8	0.62 (16.0)	1.06 (27.0)	1.12 (28.5)	...
1/2	1	1.00 (25.5)
1/2	3/4	0.88 (22.0)	1.44 (36.5)	1.47 (37.5)	...
1/2	1/2	0.75 (18.0)	1.38 (35.0)	1.38 (35.0)	1.25 (32.0)
1/2	3/8	0.62 (16.0)	1.22 (31.0)	1.25 (32.0)	...
3/4	1	1.00 (25.5)	1.81 (46.0)	1.91 (48.5)	...
3/4	3/4	0.88 (22.0)	1.66 (42.0)	1.72 (43.5)	...
3/4	1/2	0.75 (19.0)	1.62 (41.5)	1.62 (41.5)	...
1	1 1/4	1.06 (27.0)	2.09 (53.0)	2.16 (55.0)	...
1	1	1.00 (25.5)	1.97 (50.0)	2.09 (53.0)	...
1	3/4	0.88 (22.0)	1.81 (46.0)	1.91 (48.5)	...
1 1/4	2	1.12 (28.5)	...	2.38 (60.5)	...
1 1/4	1 1/2	1.06 (27.0)	2.22 (56.5)	2.28 (58.0)	...
1 1/4	1 1/4	1.06 (27.0)	2.03 (51.5)	2.22 (56.5)	...
1 1/4	1	1.06 (27.0)	2.03 (51.5)	2.12 (54.0)	...
1 1/2	2	1.12 (28.5)	...	2.50 (63.5)	...
1 1/2	1 1/2	1.06 (27.0)	2.22 (56.5)	2.41 (61.0)	...
1 1/2	1 1/4	1.06 (27.0)	2.22 (56.5)	2.34 (59.5)	...
1 1/2	1	1.00 (25.5)	...	2.25 (57.0)	...
2	2	1.12 (28.5)	2.53 (64.5)	2.75 (70.0)	...
2	1 1/2	1.12 (28.5)	...	2.66 (67.5)	...
2 1/2	2 1/2	1.38 (35.0)	3.09 (78.5)	3.12 (79.5)	...
3	3	1.50 (38.0)	3.22 (82.0)	3.41 (86.5)	...
4	4	1.69 (43.0)	3.81 (97.0)	4.12 (105.0)	...
6	6	2.00 (50.5)	5.34 (135.5)	5.75 (146.0)	...
8	8	2.25 (57.0)

GENERAL NOTES:

(a) For threaded ends, see [section 9](#).


Table 8.2-11 Dimensions of Solder Joint Adapters and Fitting Adapters With Pipe Thread Ends (Straight and Reducing Sizes) (Cont'd)

GENERAL NOTES (Cont'd):

- (b) For dimensions of threaded ends, see ASME B16.15, Class 125. For sizes not listed in ASME B16.15, Class 125, refer to ASME B16.3, Class 150. For configuration of threaded ends, see [section 10](#). For dimensions of solder joint ends, see [Table 8.2-2](#).

NOTES:


- (1) Hi-ear fittings are designed for use with $\frac{9}{16}$ in. (14 mm) maximum width strap.
 (2) For size designation of fitting, see [section 4](#).

Table 8.2-12 Dimensions of Return Bends (Straight Sizes)**Return Bend
C x C**

Standard Water Tube Size [Note (1)]	Center-to-Center, D, in. (mm)
$\frac{1}{2}$	1.00 (25.5)
$\frac{3}{4}$	1.31 (33.5)
1	1.88 (47.5)
$1\frac{1}{4}$	2.00 (51.0)
$1\frac{1}{2}$	2.50 (63.5)
2	3.00 (76.0)
3	4.00 (101.5)
4	5.00 (127.0)

GENERAL NOTE: For dimensions not given in this Table, see [Table 8.2-2](#).

NOTE: (1) For size designation of fitting, see [section 4](#).

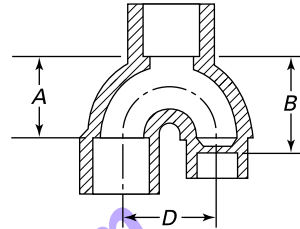Table 8.2-13 Dimensions of Supply and Return Tees**Supply and Return Tee
C x C x C**


Standard Water Tube Size [Note (1)]	Laying Lengths		Center-to-Center, D, in. (mm)
	A, in. (mm)	B, in. (mm)	
$\frac{1}{2}$	0.81 (20.5)	0.81 (20.5)	1.00 (25.5)
$\frac{3}{4}$	1.09 (28.0)	1.09 (28.0)	1.31 (33.5)
$\frac{3}{4} \times \frac{3}{4} \times \frac{1}{2}$	1.09 (28.0)	1.09 (28.0)	1.31 (33.5)
$\frac{3}{4} \times \frac{1}{2} \times \frac{1}{2}$	1.09 (28.0)	1.28 (32.5)	1.31 (33.5)

GENERAL NOTES:

- (a) For dimensions not given in this Table, see [Table 8.2-2](#).
 (b) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

NOTE: (1) For size designation of fittings, see [section 4](#).

Table 8.2-14 Dimensions of Baseboard Tees
(F × F × C)



Baseboard Tee
F × F × C


Standard Water Tube Size [Note (1)]	Laying Lengths		
	SS, in. (mm)	S, in. (mm)	Y, in. (mm)
$\frac{1}{2} \times \frac{1}{8} \times 1$	1.12 (28.5)	0.81 (20.5)	0.56 (14.5)
$\frac{1}{2} \times \frac{1}{8} \times \frac{3}{4}$	0.94 (24.0)	0.69 (17.5)	0.56 (14.5)
$\frac{3}{4} \times \frac{1}{8} \times 1$	1.19 (30.0)	0.81 (20.5)	0.69 (17.5)
$\frac{3}{4} \times \frac{1}{8} \times \frac{3}{4}$	1.00 (25.5)	0.69 (17.5)	0.69 (17.5)
$1\frac{1}{4} \times \frac{1}{8} \times 1\frac{1}{4}$	1.84 (47.0)	0.94 (24.0)	0.88 (22.0)

GENERAL NOTES:

- (a) For dimensions not given in this Table, see [Table 8.2-2](#).
(b) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

NOTE: (1) For size designation of fittings, see [section 4](#).

Table 8.2-16 Dimensions of Baseboard Tees
(C × F × C)



Baseboard Tee
C × F × C


Standard Water Tube Size [Note (1)]	Laying Lengths		
	H, in. (mm)	S, in. (mm)	V, in. (mm)
$\frac{3}{8} \times \frac{1}{8} \times \frac{3}{8}$	0.59 (15.0)	0.97 (24.5)	0.59 (15.0)
$\frac{1}{2} \times \frac{1}{8} \times 1$	0.75 (19.0)	0.81 (20.5)	0.44 (11.0)
$\frac{1}{2} \times \frac{1}{8} \times \frac{3}{4}$	0.56 (14.5)	0.69 (17.5)	0.44 (11.0)
$\frac{1}{2} \times \frac{1}{8} \times \frac{1}{2}$	0.44 (11.0)	0.56 (14.5)	0.44 (11.0)
$\frac{3}{4} \times \frac{1}{8} \times 1\frac{1}{4}$	0.81 (20.5)	0.94 (24.0)	0.56 (14.5)
$\frac{3}{4} \times \frac{1}{8} \times 1$	0.75 (19.0)	0.81 (20.5)	0.62 (16.0)
$\frac{3}{4} \times \frac{1}{8} \times \frac{3}{4}$	0.56 (11.0)	0.69 (17.5)	0.56 (11.0)
$1 \times \frac{1}{8} \times 1$	0.72 (18.0)	0.75 (19.0)	0.72 (15.0)
$1\frac{1}{4} \times \frac{1}{8} \times 1\frac{1}{4}$	0.88 (22.0)	0.94 (24.0)	0.88 (22.0)

GENERAL NOTES:

- (a) For dimensions not given in this Table, see [Table 8.2-2](#).
(b) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

NOTE: (1) For size designation of fittings, see [section 4](#).

Table 8.2-15 Dimensions of Tees




Tee
F × M × C

Standard Water Tube Size [Note (1)]	Laying Lengths		
	U, in. (mm)	P, in. (mm)	S, in. (mm)
$\frac{1}{2} \times \frac{3}{4} \times \frac{1}{2}$	0.69 (17.5)	1.22 (31.0)	0.97 (24.5)
$\frac{3}{4}$	0.69 (17.5)	1.34 (34.0)	1.00 (25.5)
$\frac{3}{4} \times \frac{3}{4} \times \frac{1}{2}$	0.69 (17.5)	1.22 (31.0)	0.97 (24.5)

GENERAL NOTES:

- (a) For dimensions not given in this Table, see [Table 8.2-2](#).
(b) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

NOTE: (1) For size designation of fittings, see [section 4](#).


Table 8.2-17 Dimensions of Flush Bushings (FTG × C)**Flush Bushing
FTG × C**

Standard Water Tube Size [Note (1)]	Laying Length, H, in. (mm)
$\frac{1}{4} \times \frac{1}{8}$	0.06 (2.0)
$\frac{3}{8} \times \frac{1}{4}$	0.06 (2.0)
$\frac{1}{2} \times \frac{3}{8}$	0.09 (2.5)
$\frac{1}{2} \times \frac{1}{4}$	0.25 (6.5)
$\frac{5}{8} \times \frac{1}{2}$	0.06 (2.0)
$\frac{3}{4} \times \frac{5}{8}$	0.19 (5.0)
$\frac{3}{4} \times \frac{1}{2}$	0.09 (2.5)
$\frac{3}{4} \times \frac{3}{8}$	0.44 (11.0)
$1 \times \frac{3}{4}$	0.12 (3.0)
$1 \times \frac{1}{2}$	0.47 (12.0)
$1\frac{1}{4} \times 1$	0.09 (2.5)
$1\frac{1}{2} \times 1\frac{1}{4}$	0.16 (4.0)
$2 \times 1\frac{1}{2}$	0.12 (3.0)

GENERAL NOTES:

- (a) For dimensions not given in this Table, see [Table 8.2-2](#).
 (b) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

NOTE: (1) For size designation of fittings, see [section 4](#).

Table 8.2-18 Dimensions of Flush Bushings (FTG × F)**Flush Bushing
FTG × F**

Standard Water Tube Size [Note (1)]	Laying Length, A, in. (mm)
$\frac{1}{2} \times \frac{1}{8}$	0.56 (14.0)
$\frac{3}{4} \times \frac{3}{8}$	0.81 (20.5)
$1 \times \frac{1}{2}$	0.97 (24.5)
$1\frac{1}{4} \times \frac{3}{4}$	1.03 (26.0)
$1\frac{1}{2} \times 1$	1.16 (29.5)
$2 \times 1\frac{1}{2}$	1.41 (35.5)

GENERAL NOTES:

- (a) For dimensions not given in this Table, see [Table 8.2-2](#).
 (b) For inspection tolerances, see [section 8](#) and [Table 8.2-1](#).

NOTE: (1) For size designation of fittings, see [section 4](#).

(18)

MANDATORY APPENDIX I REFERENCES

The following is a list of publications referenced in this Standard. Unless otherwise specified, the latest edition of ASME publications shall apply. Materials manufactured to other editions of the referenced ASTM standard shall be permitted to be used to manufacture fittings meeting the requirements of this Standard as long as the fitting manufacturer verifies the material meets the requirements of the referenced edition.

ANSI/ASME B1.20.1, Pipe Threads, General Purpose (Inch)

ASME B16.3, Malleable Iron Threaded Fittings, Classes 150 and 300

ASME B16.15, Cast Copper Alloy Threaded Fittings, Classes 125 and 250

Publisher: The American Society of Mechanical Engineers (ASME), Two Park Avenue, New York, NY 10016-5990 (www.asme.org)

ASTM B32-08 (R2014), Standard Specification for Solder Metal

ASTM B62-17, Standard Specification for Composition Bronze or Ounce Metal Castings

ASTM B88-16, Standard Specification for Seamless Copper Water Tube

ASTM B584-14, Standard Specification for Copper Alloy Sand Castings for General Applications

ASTM B828-16, Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings

ASTM E29-13, Standard Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications

Publisher: ASTM International (ASTM), 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959 (www.astm.org)

ISO 9000:2015, Quality management systems — Fundamentals and vocabulary¹

ISO 9001:2015, Quality management systems — Requirements¹

ISO 9004:2009, Managing for the sustained success of an organization — A quality management approach¹

Publisher: International Organization for Standardization (ISO), Central Secretariat, Chemin de Blandonnet 8, Case Postale 401, 1214 Vernier, Geneva, Switzerland (www.iso.org)

MSS SP-25-2013, Standard Practice Marking System for Valves, Fittings, Flanges and Unions

Publisher: Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS), 127 Park Street, NE, Vienna, VA 22180 (www.msshq.org)

¹ May also be obtained from the American National Standards Institute (ANSI), 25 West 43rd Street, New York, NY 10036.

NONMANDATORY APPENDIX A STRENGTH OF SOLDER JOINTS

The maximum recommended pressure–temperature ratings for solder joints made with copper tube and cast copper alloy pressure fittings, using representative

commercial solders, are listed in [Table A-1](#). These pressure–temperature ratings are based on solder joints made in accordance with the requirements of ASTM B828.

www.fouladline.com

Table A-1 Pressure–Temperature Ratings

Joining Material	Working Temp., °F (°C)	Maximum Working Gage Pressure, psi (kPa), for Standard Water Tube Sizes [Note (1)]				
		1/8 Through 1	1/4 Through 2	2 1/2 Through 4	5 Through 8	10 Through 12
Alloy Sn50	100 (38)	200 (1 375)	175 (1 205)	150 (1 030)	135 (930)	100 (685)
50-50 tin–lead	150 (66)	150 (1 030)	125 (860)	100 (685)	90 (620)	70 (480)
solder [Notes (2), (3)]	200 (93)	100 (685)	90 (620)	75 (515)	70 (480)	50 (340)
	250 (120)	85 (585)	75 (515)	50 (340)	45 (310)	40 (275)
Alloy Sb5 95-5	100 (38)	1,090 (7 540) [Note (5)]	850 (5 880) [Note (6)]	705 (4 880) [Note (6)]	660 (4 555) [Note (6)]	500 (3 460) [Note (5)]
tin–antimony	150 (66)	625 (4 315) [Note (7)]	485 (3 365) [Note (7)]	405 (2 790) [Note (7)]	375 (2 605) [Note (7)]	285 (1 975) [Note (8)]
solder [Note (4)]	200 (93)	505 (3 500) [Note (8)]	395 (2 730) [Note (7)]	325 (2 265) [Note (7)]	305 (2 115) [Note (7)]	230 (1 605) [Note (8)]
	250 (120)	270 (1 885)	210 (1 475)	175 (1 220)	165 (1 135)	125 (865)
Alloy E [Note (9)]	100 (38)	710 (4 905) [Note (7)]	555 (3 825) [Note (7)]	460 (3 175) [Note (7)]	430 (2 965) [Note (7)]	325 (2 255) [Note (8)]
	150 (66)	475 (3 275) [Note (8)]	370 (2 550) [Note (7)]	305 (2 115) [Note (7)]	285 (1 975) [Note (8)]	215 (1 500) [Note (8)]
	200 (93)	375 (2 595)	290 (2 025)	240 (1 680) [Note (8)]	225 (1 570) [Note (8)]	170 (1 190)
	250 (120)	320 (2 230)	250 (1 735)	205 (1 440)	195 (1 340)	145 (1 020)
Alloy HB [Note (10)]	100 (38)	1,035 (7 135) [Note (5)]	805 (5 560) [Note (6)]	670 (4 615) [Note (6)]	625 (4 305) [Note (5)]	475 (3 275) [Note (5)]
	150 (66)	710 (4 905) [Note (7)]	555 (3 825) [Note (7)]	460 (3 175) [Note (7)]	430 (2 965) [Note (7)]	325 (2 255) [Note (7)]
	200 (93)	440 (3 045) [Note (8)]	345 (2 375) [Note (8)]	285 (1 970) [Note (8)]	265 (1 840) [Note (8)]	200 (1 400)
	250 (120)	430 (2 970) [Note (8)]	335 (2 315) [Note (8)]	275 (1 920) [Note (8)]	260 (1 800) [Note (8)]	195 (1 365)
Joining materials melting at or above 1,100°F (593°C) [Note (11)]		Pressure–temperature ratings consistent with the materials and procedures used.				

GENERAL NOTE: For extremely low working temperatures in the 0°F to –200°F (–18°C to –93°C) range, it is recommended that a joint material melting at or above 1,100°F (593°C) be used [see Note (11)].

NOTES:

- (1) Standard water tube sizes per ASTM B88.
- (2) ASTM B32 Alloy Grade Sn50.
- (3) The Safe Drinking Water Act Amendments of 1986 prohibit the use in potable water systems of any solder having a lead content in excess of 0.2%.
- (4) ASTM B32 Alloy Grade Sb5.
- (5) The solder joint exceeds the strength of Types L and M tube in drawn temper and Type K tube in annealed temper.
- (6) The solder joint exceeds the strength of Types K, L, and M tube in drawn and annealed tempers.
- (7) The solder joint exceeds the strength of Type M tube in drawn temper and Types K and L tube in annealed temper.
- (8) The solder joint exceeds the strength of Type L tube in annealed temper.
- (9) ASTM B32 Alloy Grade E.
- (10) ASTM B32 Alloy Grade HB.
- (11) These joining materials are defined as *brazing alloys* by the American Welding Society.

NONMANDATORY APPENDIX B

FITTING RATING

The rated internal working pressures of the fitting are shown in [Table 3.1-1](#). These values are the same as those calculated for annealed temper ASTM B88 Type L copper water tube. The rated internal working pressures for annealed temper ASTM B88 Type L copper water tube are calculated as follows:

$$P = \frac{2St}{D - 0.8t}$$

where

D = maximum outside diameter, in., from annealed temper ASTM B88 for Type L copper water tube

P = rated working pressure at temperature, psi

S = allowable stress at temperature, psi, from ASME B31.1 or ASME B31.9 for annealed temper ASTM B88 Type L copper water tube

t = minimum wall thickness, in., from annealed temper ASTM B88 for Type L copper water tube

NONMANDATORY APPENDIX C QUALITY SYSTEM PROGRAM

The products manufactured in accordance with this Standard shall be produced under a quality system program following the principles of an appropriate standard from the ISO 9000 series.¹ A determination of the need for registration and/or certification of the product manufacturer's quality system program by an independent organization shall be the responsibility of the manufacturer. The detailed documentation demon-

strating program compliance shall be available to the purchaser at the manufacturer's facility. A written summary description of the program utilized by the product manufacturer shall be available to the purchaser upon request. The product manufacturer is defined as the entity whose name, or trademark, appears on the product in accordance with the marking or identification requirements of this Standard.

¹ The series is also available from the American National Standards Institute (ANSI) and the American Society for Quality (ASQ) as American National Standards that are identified by the prefix "Q," replacing the prefix "ISO." Each standard of the series is listed under References in [Mandatory Appendix I](#).

B16 AMERICAN NATIONAL STANDARDS FOR PIPING, PIPE FLANGES, FITTINGS, AND VALVES

B16.1-2015	Gray Iron Pipe Flanges and Flanged Fittings (Classes 25, 125, and 250)
B16.3-2016	Malleable Iron Threaded Fittings: Classes 150 and 300
B16.4-2016	Gray Iron Threaded Fittings: Classes 125 and 250
B16.5-2017	Pipe Flanges and Flanged Fittings NPS ½ Through NPS 24 Metric/Inch Standard
B16.9-2018	Factory-Made Wrought Butt welding Fittings
B16.10-2017	Face-to-Face and End-to-End Dimensions of Valves
B16.11-2016	Forged Fittings, Socket-Welding and Threaded
B16.12-2009 (R2014)	Cast Iron Threaded Drainage Fittings
B16.14-2013	Ferrous Pipe Plugs, Bushings, and Locknuts With Pipe Threads
B16.15-2013	Cast Copper Alloy Threaded Fittings
B16.18-2018	Cast Copper Alloy Solder Joint Pressure Fittings
B16.20-2017	Metallic Gaskets for Pipe Flanges
B16.21-2016	Nonmetallic Flat Gaskets for Pipe Flanges
B16.22-2013	Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings
B16.23-2016	Cast Copper Alloy Solder Joint Drainage Fittings: DWV
B16.24-2016	Cast Copper Alloy Pipe Flanges, Flanged Fittings, and Valves: Classes 150, 300, 600, 900, 1500, and 2500
B16.25-2017	Butt welding Ends
B16.26-2013	Cast Copper Alloy Fittings for Flared Copper Tubes
B16.29-2017	Wrought Copper and Wrought Copper Alloy Solder-Joint Drainage Fittings — DWV
B16.33-2012 (R2017)	Manually Operated Metallic Gas Valves for Use in Gas Piping Systems Up to 175 psi (Sizes NPS ½ Through NPS 2)
B16.34-2017	Valves — Flanged, Threaded, and Welding End
B16.36-2015	Orifice Flanges
B16.38-2012 (R2017)	Large Metallic Valves for Gas Distribution: Manually Operated, NPS 2½ (DN 65) to NPS 12 (DN 300), 125 psig (8.6 bar) Maximum
B16.39-2014	Malleable Iron Threaded Pipe Unions: Classes 150, 250, and 300
B16.40-2013	Manually Operated Thermoplastic Gas Shutoffs and Valves in Gas Distribution Systems
B16.42-2016	Ductile Iron Pipe Flanges and Flanged Fittings: Classes 150 and 300
B16.44-2012 (R2017)	Manually Operated Metallic Gas Valves for Use in Aboveground Piping Systems Up to 5 psi
B16.47-2017	Large Diameter Steel Flanges NPS 26 Through NPS 60 Metric/Inch Standard
B16.48-2015	Line Blanks
B16.49-2017	Factory-Made, Wrought Steel, Butt welding Induction Bends for Transportation and Distribution Systems
B16.50-2013	Wrought Copper and Copper Alloy Braze-Joint Pressure Fittings
B16.51-2013	Copper and Copper Alloy Press-Connect Pressure Fittings
B16.52-2018	Forged Nonferrous Fittings, Socket-Welding and Threaded (Titanium, Titanium Alloys, Aluminum, and Aluminum Alloys)

The ASME Publications Catalog shows a complete list of all the Standards published by the Society. For a complimentary catalog, or the latest information about our publications, call 1-800-THE-ASME (1-800-843-2763).

ASME Services

ASME is committed to developing and delivering technical information. At ASME's Customer Care, we make every effort to answer your questions and expedite your orders. Our representatives are ready to assist you in the following areas:

ASME Press	Member Services & Benefits	Public Information
<i>Codes & Standards</i>	Other ASME Programs	Self-Study Courses
Credit Card Orders	Payment Inquiries	Shipping Information
IMechE Publications	Professional Development	Subscriptions/Journals/Magazines
Meetings & Conferences	Short Courses	Symposia Volumes
Member Dues Status	Publications	Technical Papers

How can you reach us? It's easier than ever!

There are four options for making inquiries* or placing orders. Simply mail, phone, fax, or E-mail us and a Customer Care representative will handle your request.

Mail

ASME

150 Clove Road, 6th Floor
Little Falls, New Jersey
07424-2139

Call Toll Free

US & Canada: 800-THE-ASME
(800-843-2763)

Mexico: 95-800-THE-ASME
(95-800-843-2763)

Fax—24 hours

973-882-1717
973-882-5155

E-Mail—24 hours

customercare@asme.org

*Customer Care staff are not permitted to answer inquiries about the technical content of this code or standard. Information as to whether or not technical inquiries are issued to this code or standard is shown on the copyright page. All technical inquiries must be submitted in writing to the staff secretary. Additional procedures for inquiries may be listed within.

www.fouladline.com

I S B N 978-0-7918-7207-9

